


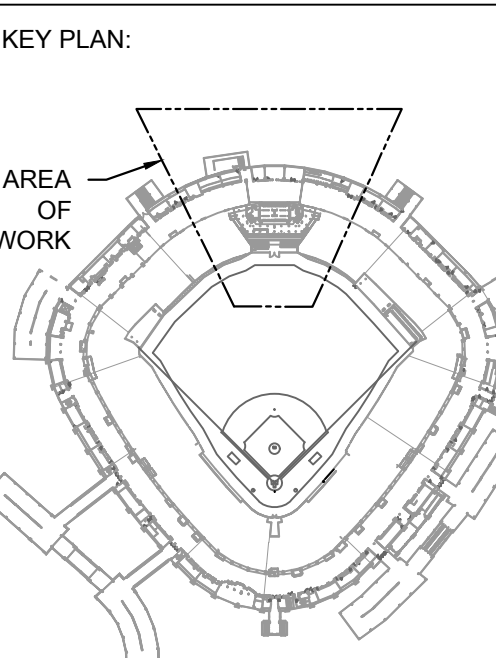

ISSUE/REVISION:		
REV.	DATE	DESCRIPTION
	10/03/2023	ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - SERVICE LEVEL
- SECTION 1

DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"
SHEET NO:

E1.001

KEYED ELECTRICAL NEW WORK SHEET NOTES

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - SERVICE LEVEL - SECTION 1 ENLARGED
SCALE: 1/8" = 1'-0"

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION




KEYED ELECTRICAL NEW WORK SHEET NOTES

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - SERVICE LEVEL - SECTION 2 ENLARGED

SCALE: 1/8" = 1'-0"

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

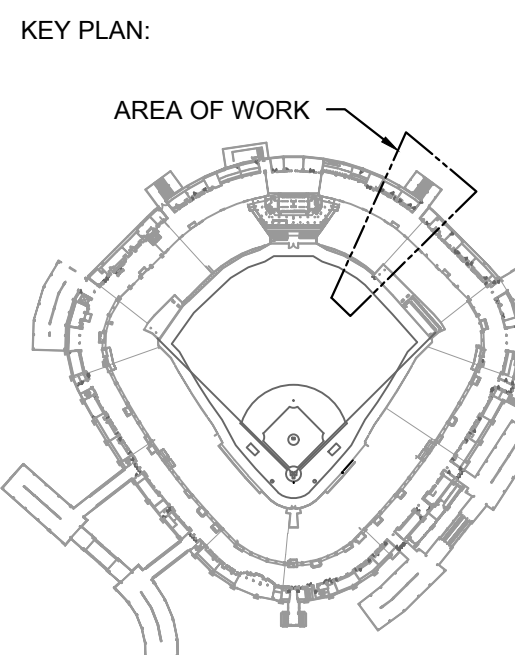

ISSUE/REVISION:		
REV.	DATE	DESCRIPTION
	10/03/2023	ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - SERVICE LEVEL
- SECTION 2

DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"

SHEET NO.



KEYED ELECTRICAL NEW WORK SHEET NOTES

A2. ALTERNATE 2: FURNISH AND INSTALL WEATHER PROOF VISUAL FIRE ALARM DEVICE. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASE ON FIELD CONDITIONS.

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - SERVICE LEVEL - SECTION 4 ENLARGED

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

elaraeng.com | (708) 236-0300

ILLINOIS SPORTS FACILITIES AUTHORITY

KEY PLAN:

ISSUE/REVISION:		
REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
2	10/03/2023	ADDENDUM 1
3	10/03/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - SERVICE LEVEL
- SECTION 4

DESIGNED BY:	MR
CHECKED BY:	BT
PROJECT NO:	22096
SCALE:	1/8" = 1'-0"
SHEET NO.	


E1.004

KEYED ELECTRICAL NEW WORK SHEET NOTES

- A2. ALTERNATE 2: FURNISH AND INSTALL WEATHER PROOF VISUAL FIRE ALARM DEVICE. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASE ON FIELD CONDITIONS.
- A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.



KEY PLAN:

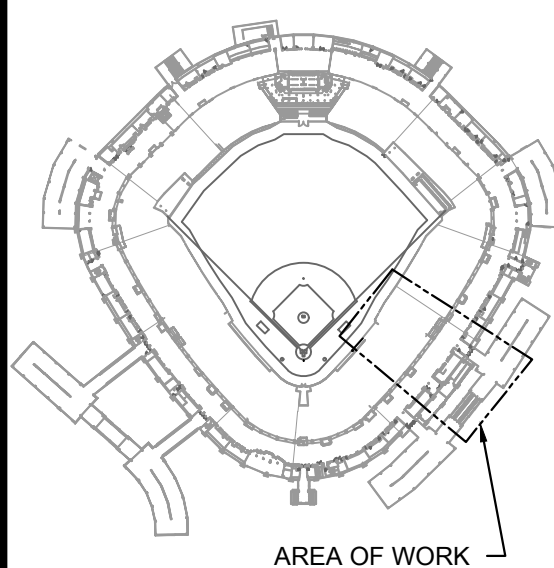

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
2	10/03/2023	ADDENDUM 1
3	10/03/2023	ADDENDUM 2

PROJECT:

GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:

ELECTRICAL FIRE ALARM NEW
WORK PLAN - SERVICE LEVEL
- SECTION 5

DESIGNED BY: MR

CHECKED BY: BT

PROJECT NO: 22096

SCALE: 1/8" = 1'-0"

SHEET NO:


10/03/2023

ISSUED FOR BID

PRELIMINARY - NOT FOR CONSTRUCTION

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - SERVICE LEVEL - SECTION 5 ENLARGED

SCALE: 1/8" = 1'-0"

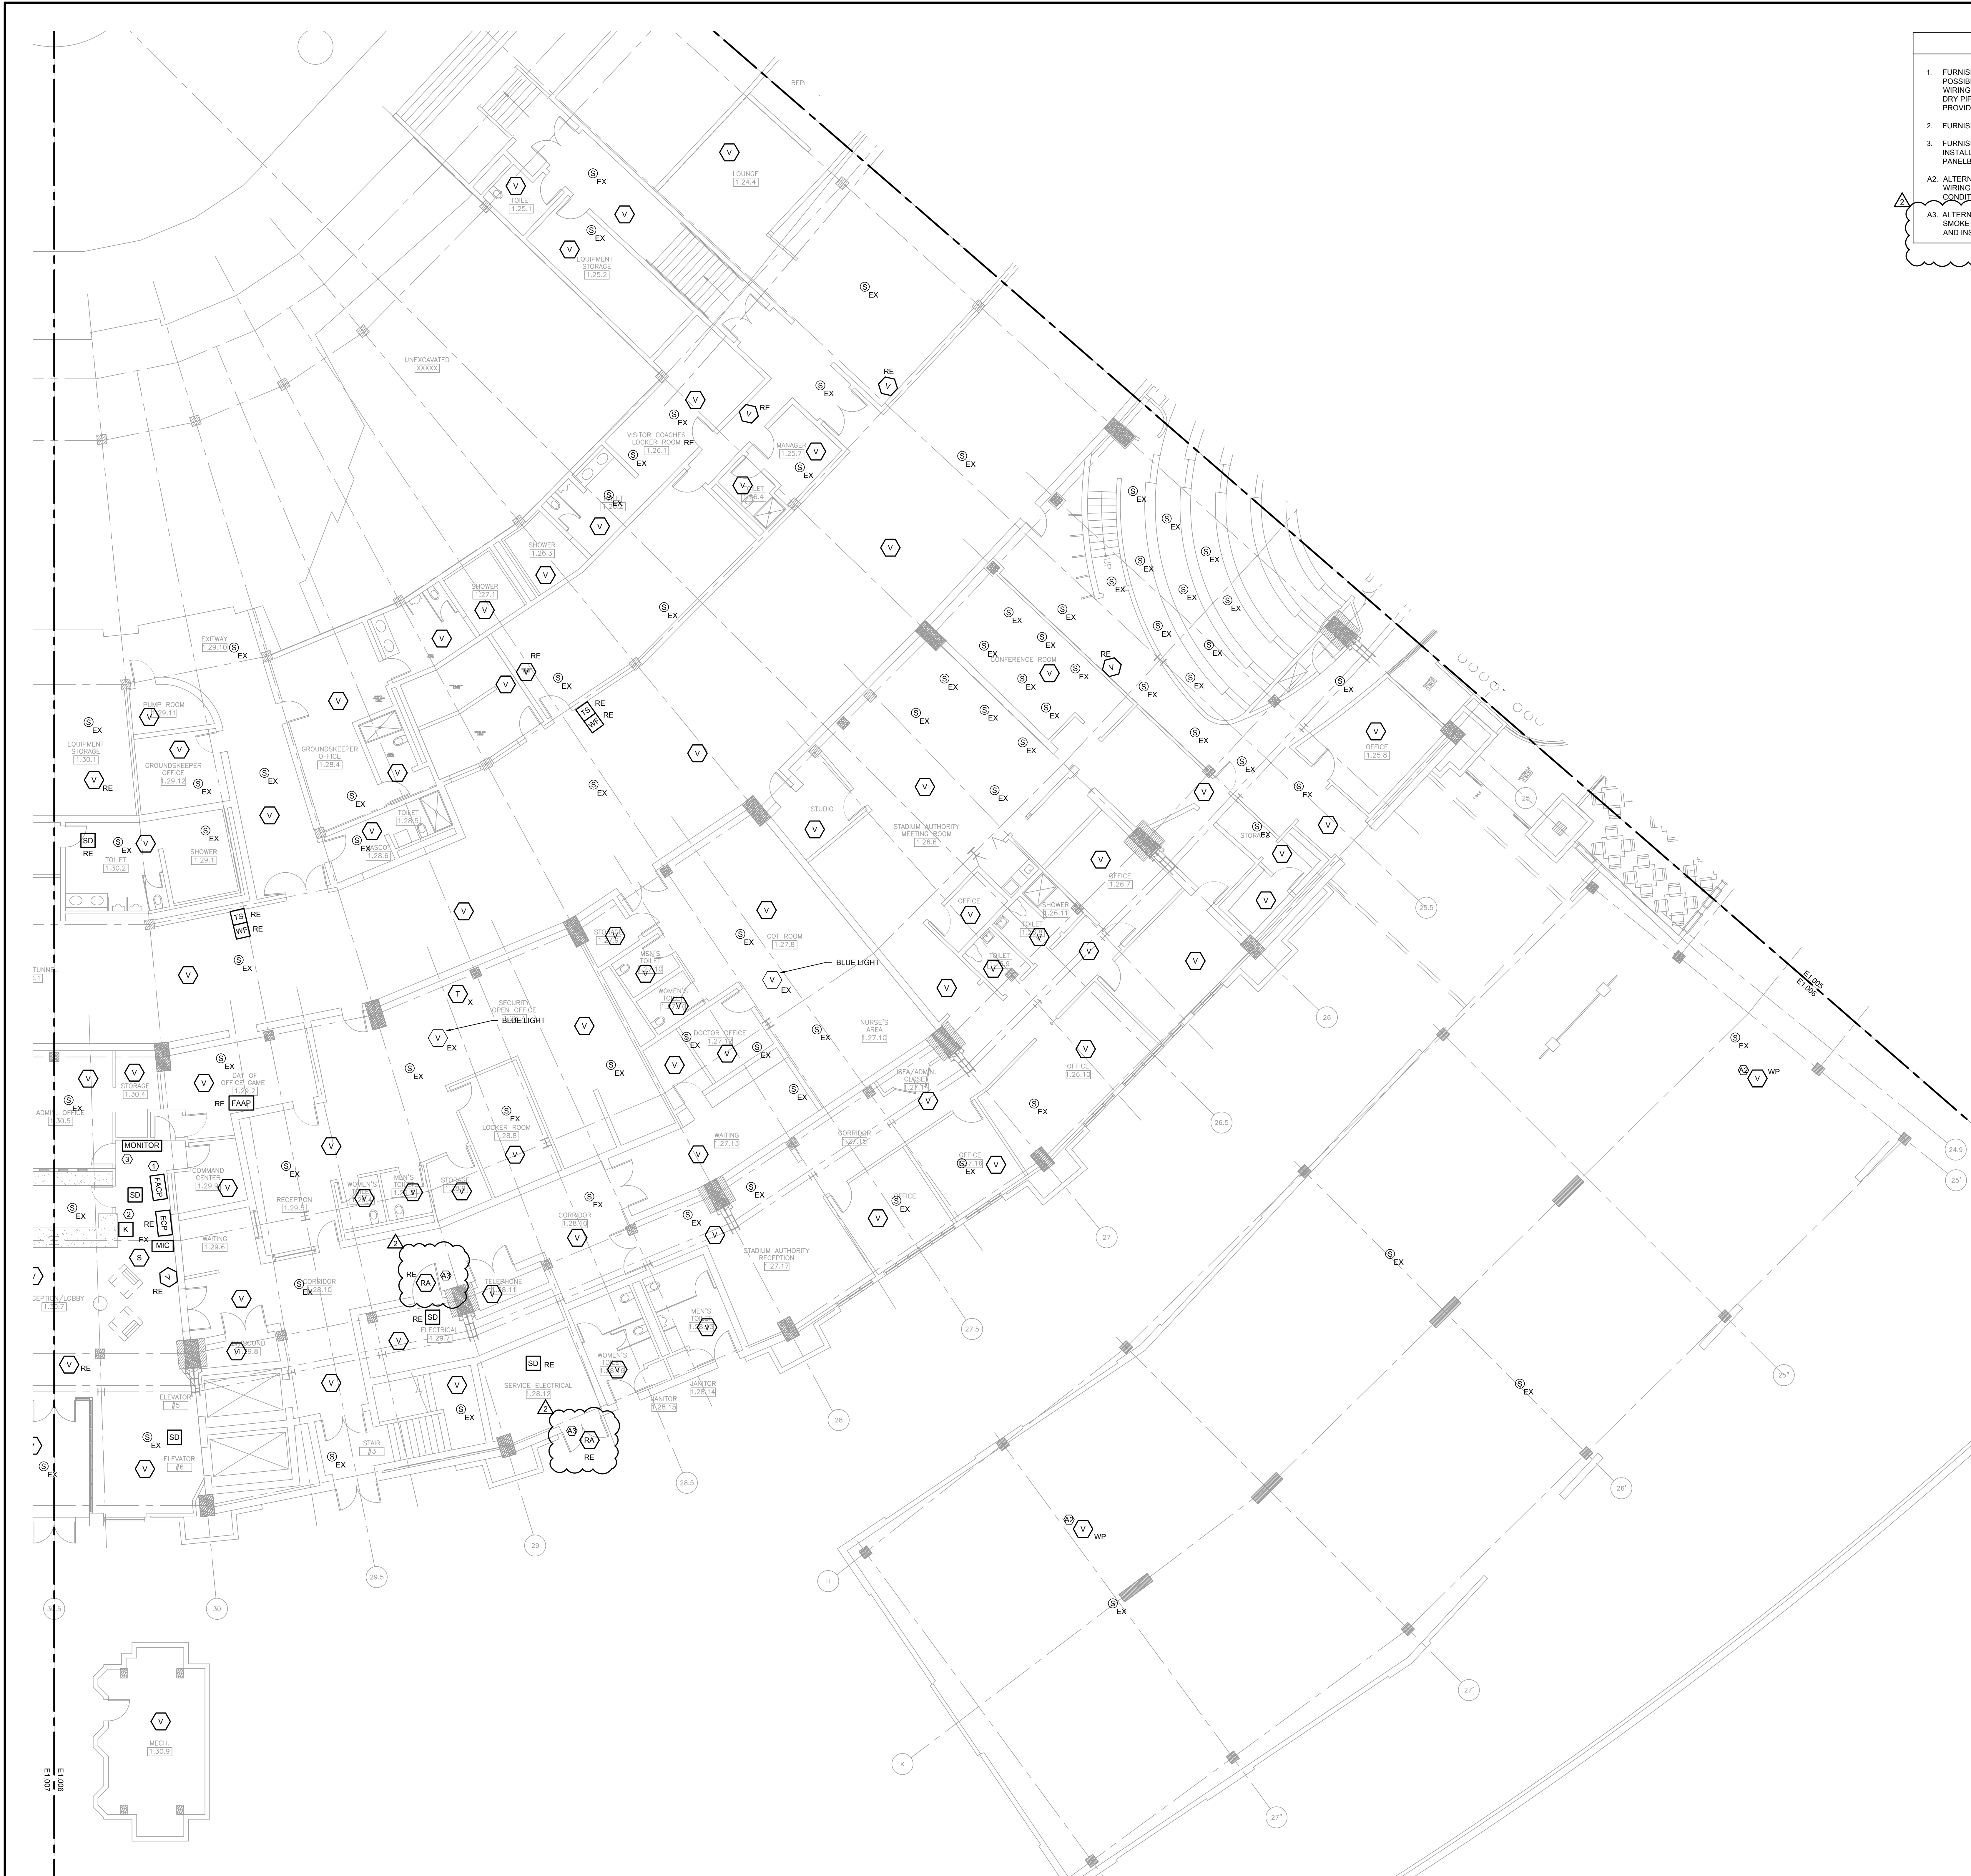

KEYED ELECTRICAL NEW WORK SHEET NOTES


1. FURNISH AND INSTALL NEW FIRE ALARM CONTROL PANEL. UTILIZE EXISTING FIRE ALARM TUB TO BEST EXTENT POSSIBLE. UTILIZE EXISTING 120V POWER. RECONNECT EXISTING FIRE ALARM DEPARTMENT COMMUNICATION WIRING. THE EXISTING ALL ATS SWITCHES, FIRE PUMP, GENERATOR, WET PIPE WATER FLOW, TAMPER SWITCHES, DRY PIPE SYSTEM, DUCT SMOKE DETECTOR, ETC. SHALL BE RECONNECTED TO NEW FIRE ALARM CONTROL PANEL. PROVIDE FIRE ALARM RELAY, MONITOR MODULE, OR OTHER DEVICE AS REQUIRED.

2. FURNISH AND INSTALL KEYBOX FOR THE KEY THAT REQUIRED FOR THE FIRE DEPARTMENT.

3. FURNISH AND INSTALL 32" TOUCH SCREEN MONITOR FOR THE FIRE ALARM GRAPHIC ANNUNCIATION. FURNISH AND INSTALL DUPLEX RECEPTACLE WITH 120V EMERGENCY BRANCH CIRCUIT FROM THE NEAREST EMERGENCY PANELBOARD.

A2. ALTERNATE 2: FURNISH AND INSTALL WEATHER PROOF VISUAL FIRE ALARM DEVICE. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASE ON FIELD CONDITIONS.

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

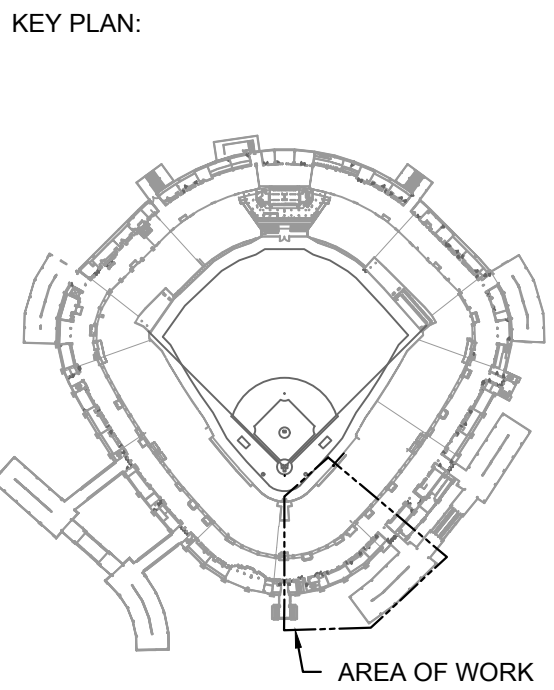

ISSUE/REVISION:		
REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
2	10/03/2023	ADDENDUM 1
3	10/03/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - SERVICE LEVEL
- SECTION 6

DESIGNED BY:	MR
CHECKED BY:	BT
PROJECT NO:	22096
SCALE:	1/8" = 1'-0"
SHEET NO.	

10/03/2023ISSUED FOR BID

PRELIMINARY - NOT FOR CONSTRUCTION


E1.006

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - SERVICE LEVEL - SECTION 6 ENLARGED



KEYED ELECTRICAL NEW WORK SHEET NOTES

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

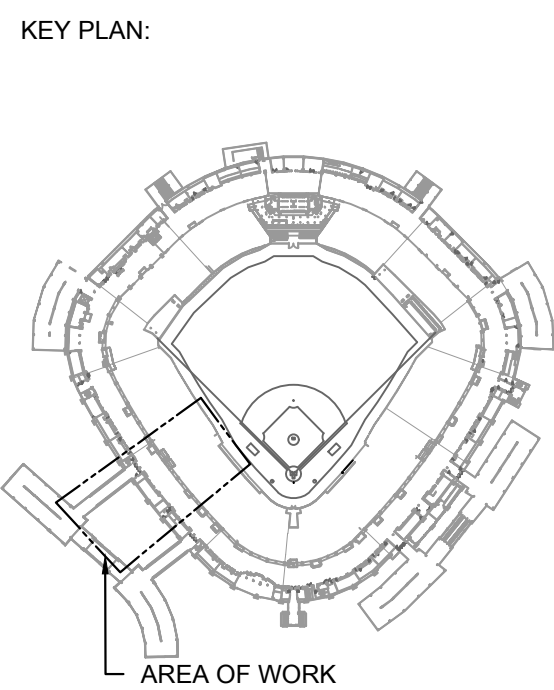

ISSUE/REVISION:		
REV.	DATE	DESCRIPTION
1	10/18/2023	ISSUED FOR BID
2	10/18/2023	ADDENDUM 1
3	10/18/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - SERVICE LEVEL
- SECTION 8


DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"
SHEET NO.



1 ELECTRICAL FIRE ALARM NEW WORK PLAN - SERVICE LEVEL - SECTION 9 ENLARGED

KEYED ELECTRICAL NEW WORK SHEET NOTES

A3. ALTERNATE 3. FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

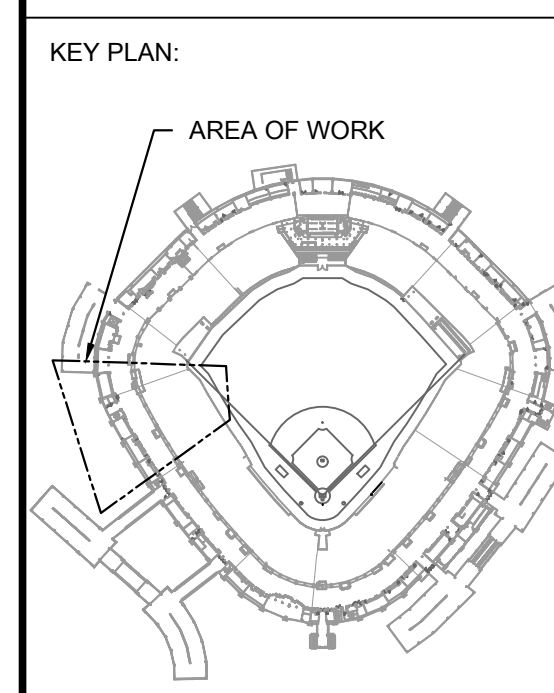

ISSUE/REVISION:		
REV.	DATE	DESCRIPTION
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT


333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - SERVICE LEVEL
- SECTION 9

DESIGNED BY:	MR
CHECKED BY:	BT
PROJECT NO:	22096
SCALE:	1/8" = 1'-0"
SHEET NO.	

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

E1.009

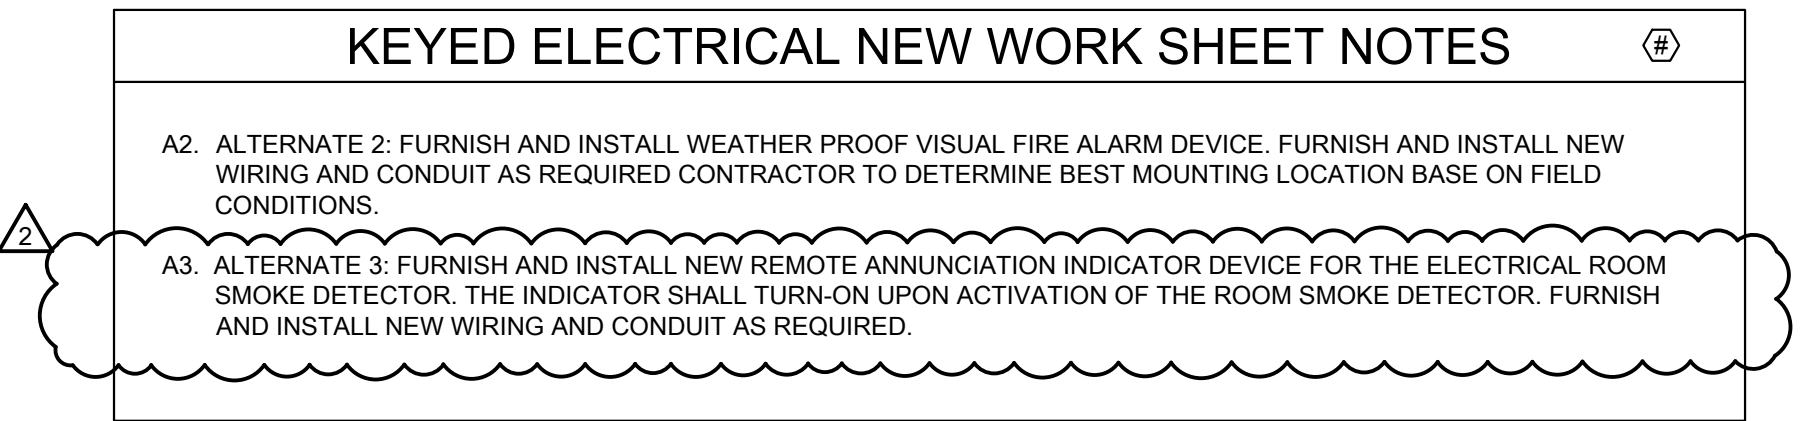

ELARA
araeng.com | (708) 236-0300

ISFA
ILLINOIS SPORTS
FEDERATION AUTHORITY



A diagram of a baseball field from a top-down perspective. A dashed line outlines a rectangular area on the left side of the field, labeled 'AREA OF WORK' with a leader line. The diagram shows the bases, pitcher's mound, and outfield.

[illegible]

GUARANTEED RATE FIELD -
ALARM REPLACEMENT

PROJECT TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - SERVICE LEVEL
SECTION 10


DESIGNED BY:	MR
CHECKED BY:	BT
PROJECT NO:	22096
SCALE:	1/8" = 1'-0"
DATE:	

E1.010

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - SERVICE LEVEL - SECTION 10 ENLARGED

10/03/2023	ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION	

E1.010

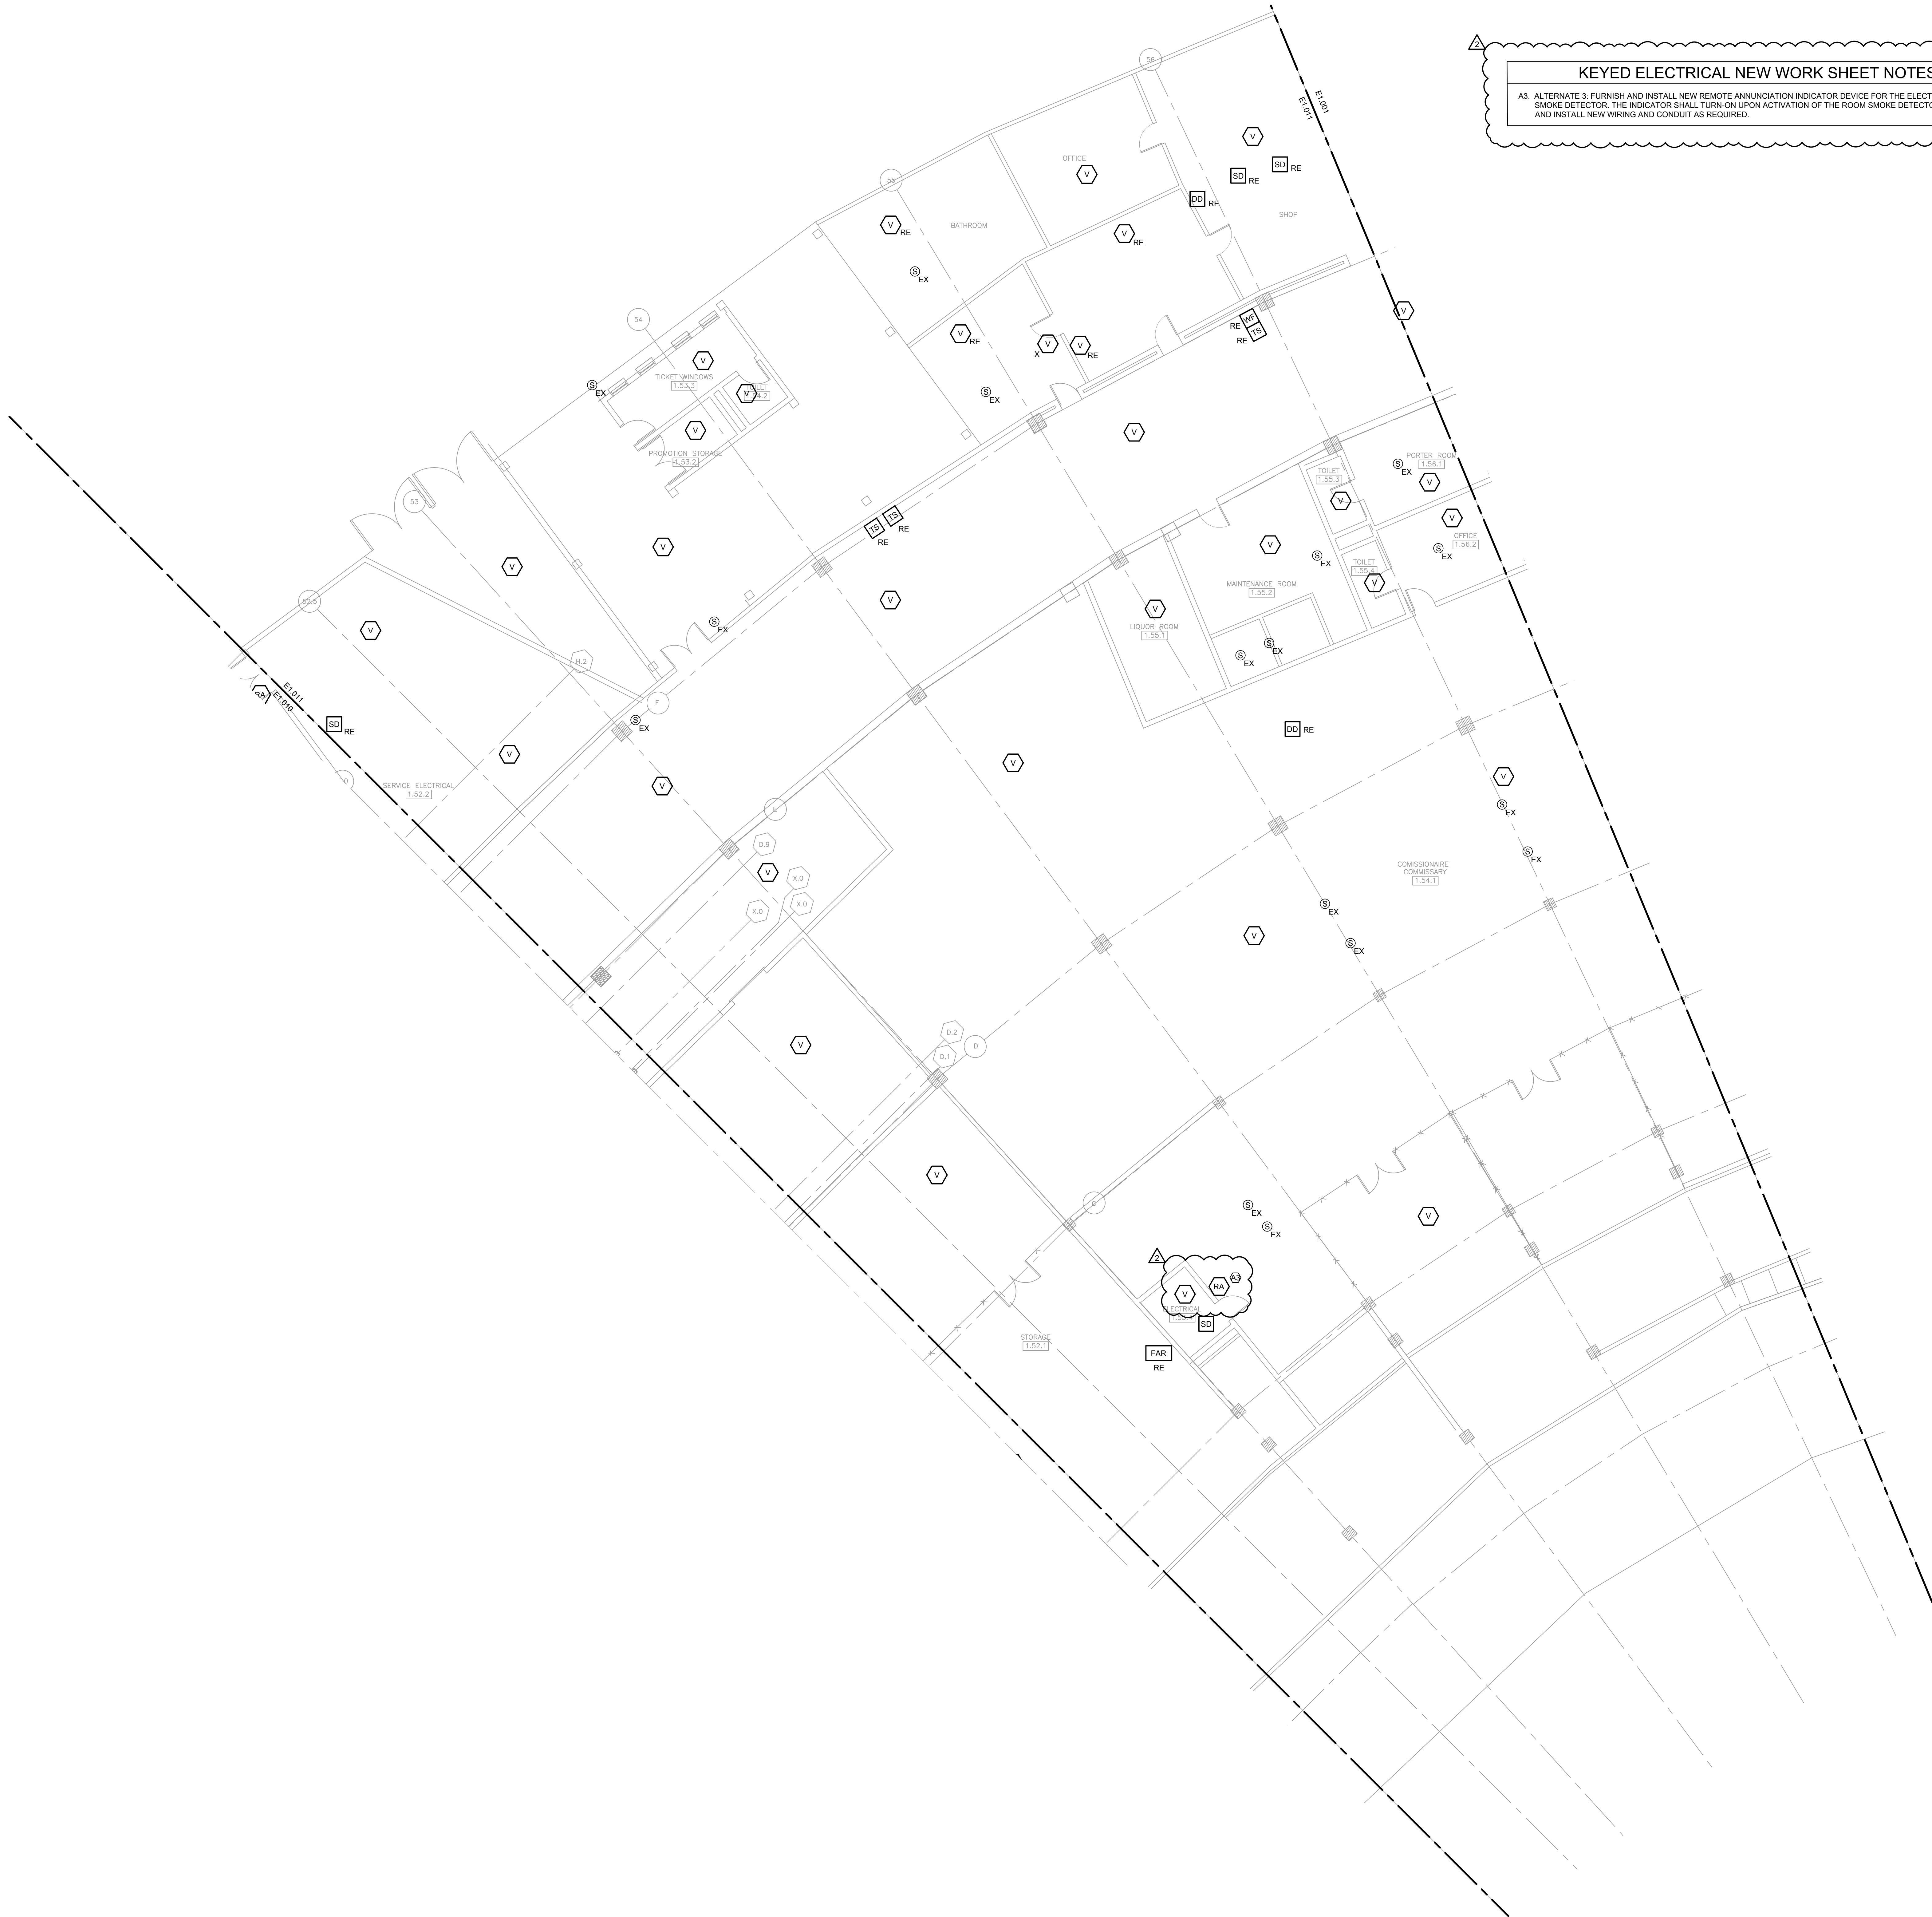


KEYED ELECTRICAL NEW WORK SHEET NOTES

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - SERVICE LEVEL - SECTION 11 ENLARGED

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

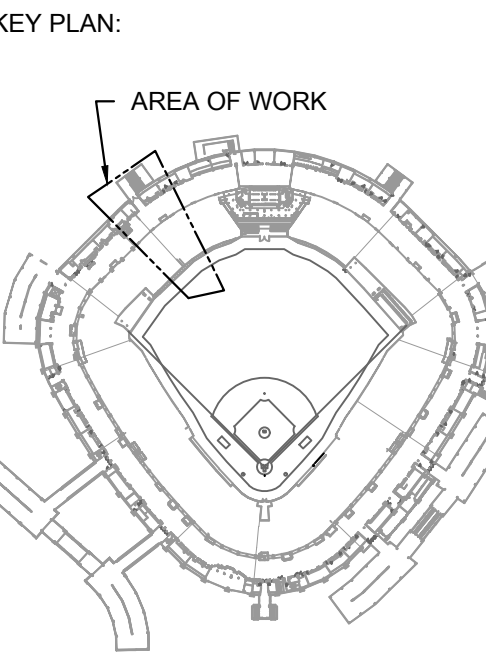

ISSUE/REVISION:		
REV.	DATE	DESCRIPTION
	10/03/2023	ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - SERVICE LEVEL
- SECTION 11


DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"
SHEET NO:

E1.011




PRELIMINARY - NOT FOR CONSTRUCTION

E1.101

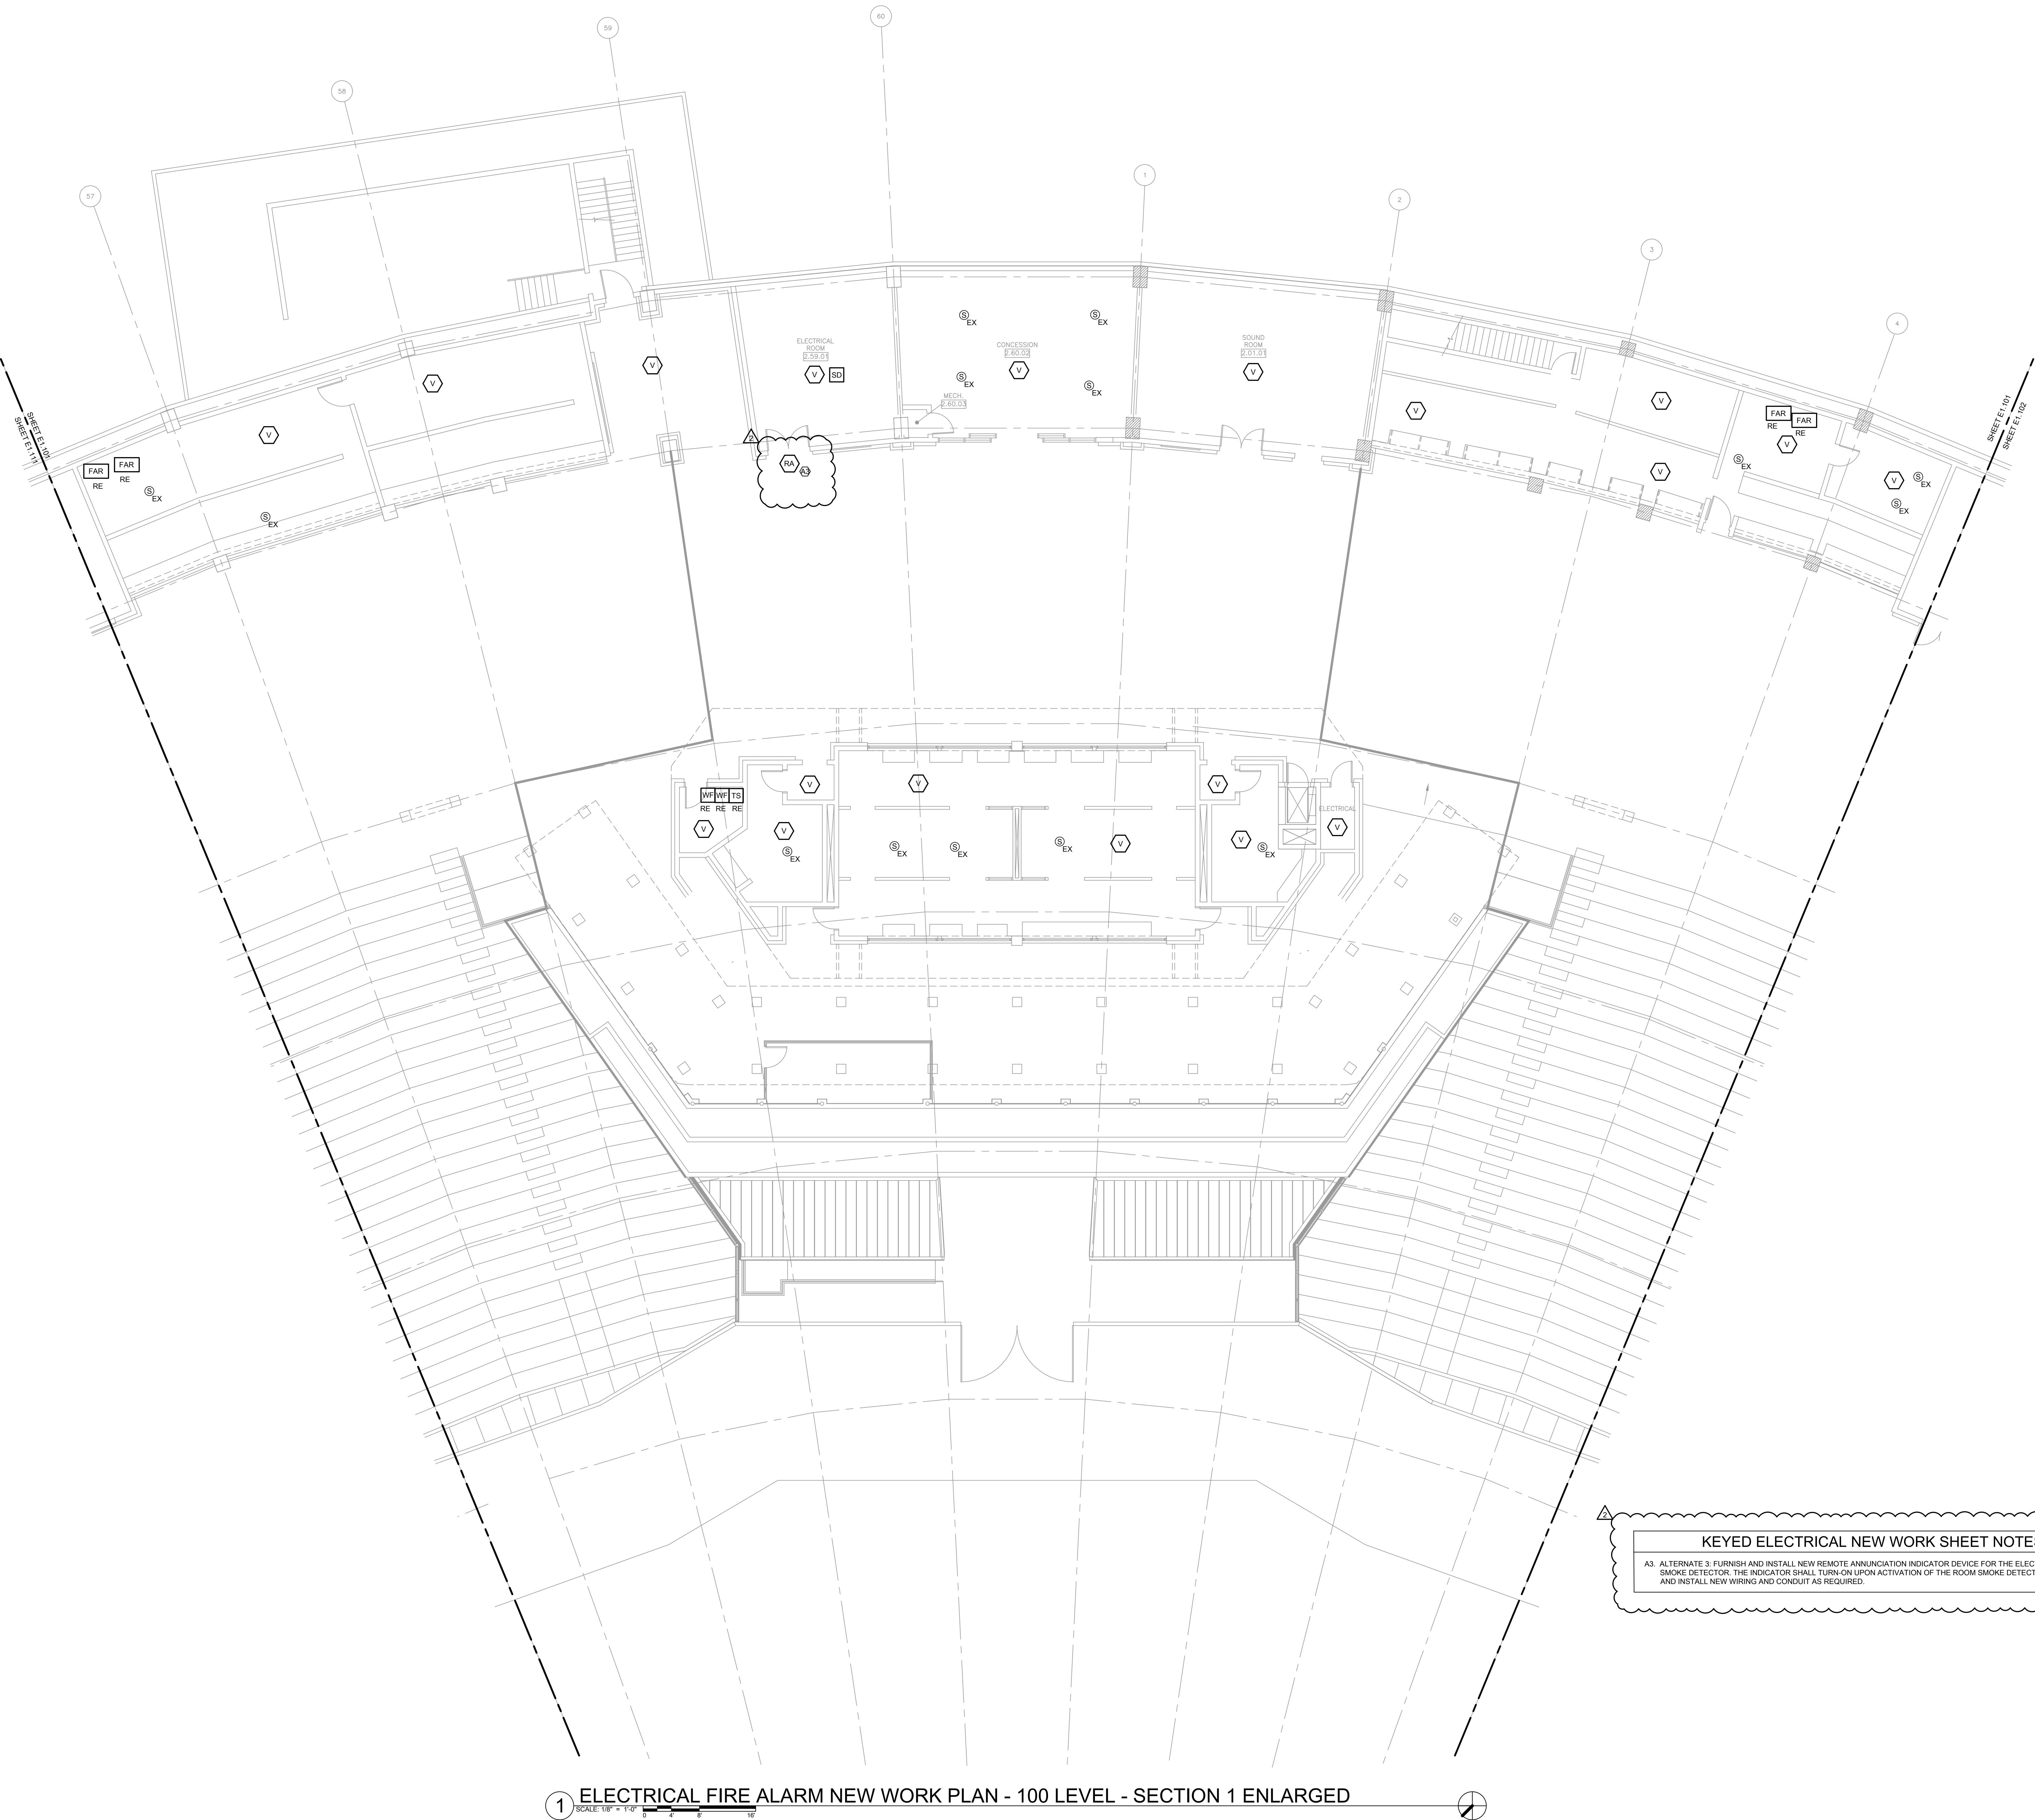

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 100 LEVEL - SECTION 1 ENLARGED
SCALE: 1/8" = 1'-0"

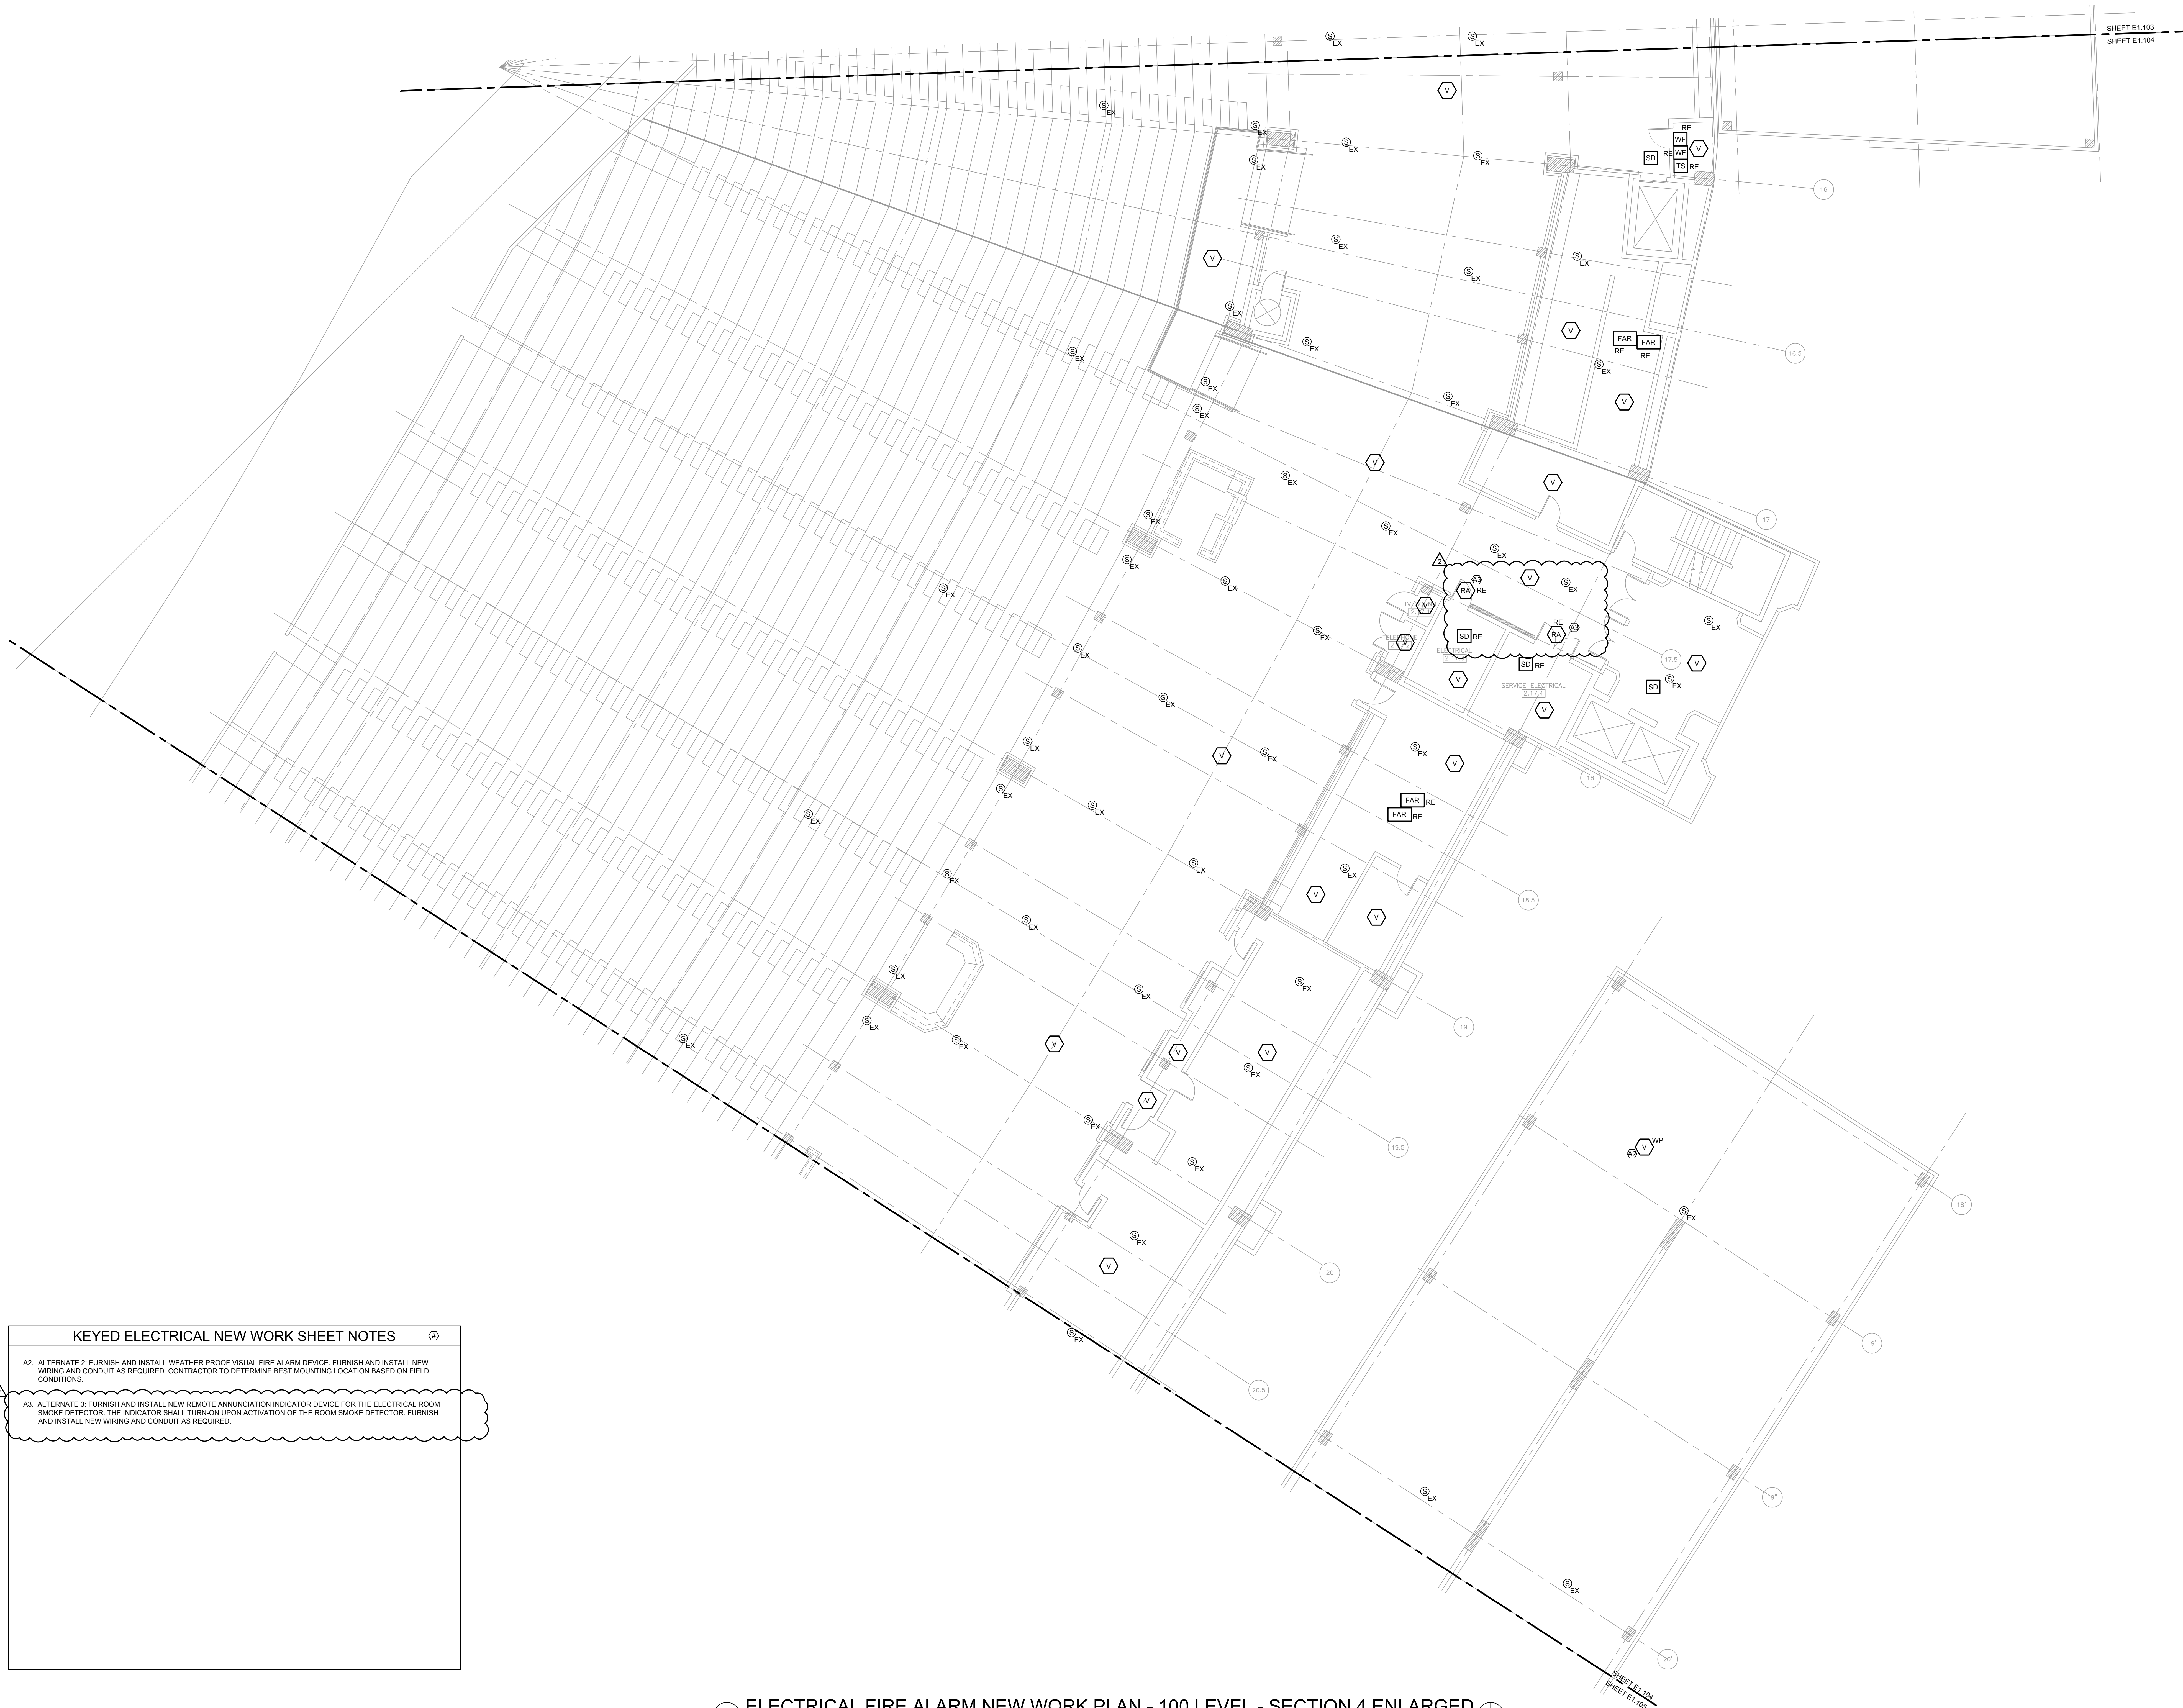

SHEET E1.103
SHEET E1.104

KEYED ELECTRICAL NEW WORK SHEET NOTES


- A2. ALTERNATE 2: FURNISH AND INSTALL WEATHER PROOF VISUAL FIRE ALARM DEVICE. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.
- A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 100 LEVEL - SECTION 4 ENLARGED

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION



KEY PLAN:

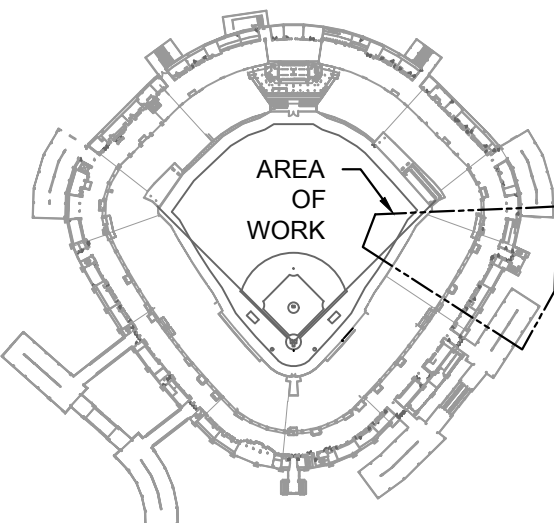

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/20/2023	ADDENDUM 2

PROJECT:

GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:

ELECTRICAL FIRE ALARM NEW
WORK PLAN - 100 LEVEL -
SECTION 4

DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"
SHEET NO:

E1.104


KEYED ELECTRICAL NEW WORK SHEET NOTES

A2. ALTERNATE 2: FURNISH AND INSTALL WEATHER PROOF VISUAL FIRE ALARM DEVICE. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.



KEY PLAN:

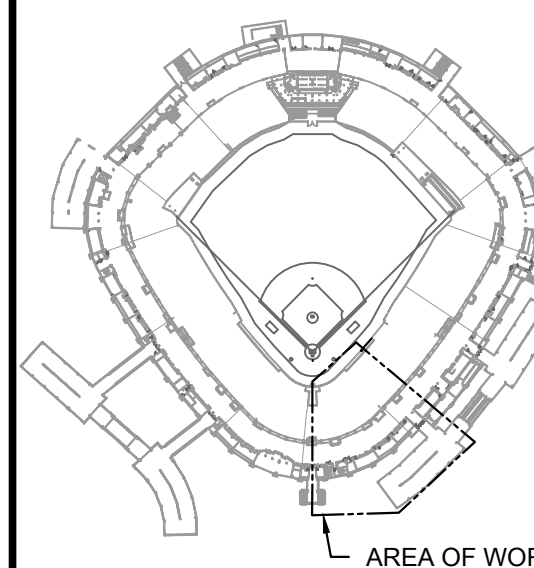

AREA OF WORK

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
2	10/03/2023	ADDENDUM 1
3	10/03/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - 100 LEVEL -
SECTION 6

DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"

SHEET NO.

E1.106

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 100 LEVEL - SECTION 6 ENLARGED

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION





A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.



DATE	DESCRIPTION
10/03/2023	ISSUED FOR BID
10/18/2023	ADDENDUM 1
10/23/2023	ADDENDUM 2

SIGNED BY:	MR
CHECKED BY:	BT
PROJECT NO:	22096
SCALE:	1/8" = 1'-0"
SHEET NO.	

E1.109

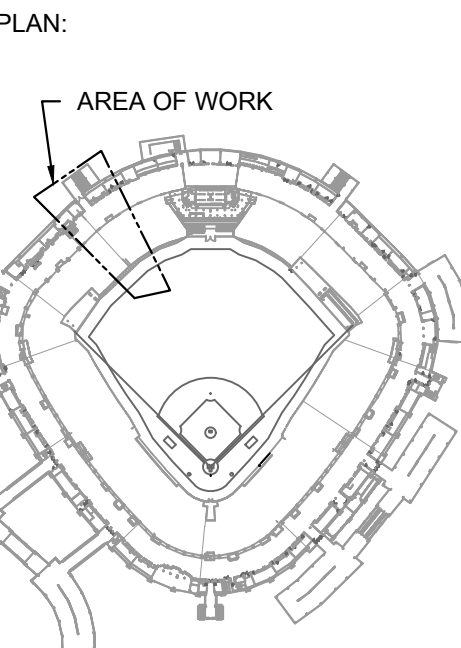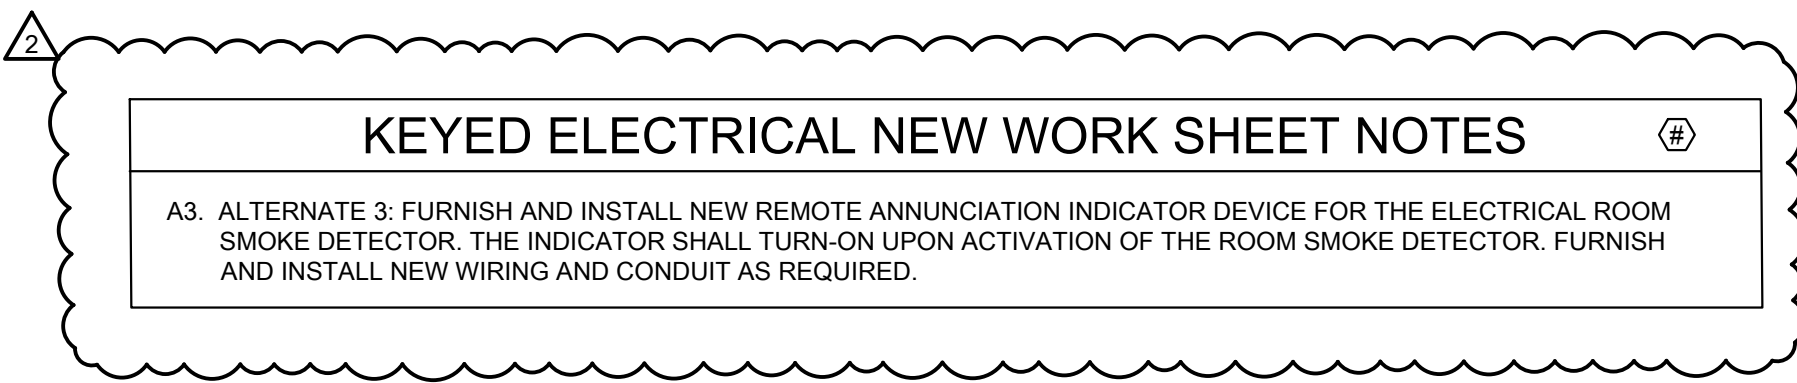

REVISION:	
DATE	DESCRIPTION
03/03/2023	ISSUED FOR BID
03/18/2023	ADDENDUM 1
03/23/2023	ADDENDUM 2

WARRANTED RATE FIELD -
ALARM REPLACEMENT

PROJECT TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - 100 LEVEL -
SECTION 11

DESIGNED BY:	MR
CHECKED BY:	BT
PROJECT NO:	22096
SCALE:	1/8" = 1'-0"
DATE:	

T NO.

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 100 LEVEL - SECTION 11 ENLARGED

10/03/2023 ISSUED FOR BID

PRELIMINARY - NOT FOR CONSTRUCTION

E1.111



KEYED ELECTRICAL NEW WORK SHEET NOTES

A1. ALTERNATE 1: FURNISH AND INSTALL VISUAL FIRE ALARM DEVICE IN ROOM AS INDICATED. FURNISH AND INSTALL NEW FIRE ALARM CONDUIT AND WIRING AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.

A2. ALTERNATE 2: FURNISH AND INSTALL WEATHER PROOF VISUAL FIRE ALARM DEVICE. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 200 LEVEL - SECTION 4 ENLARGED

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

KEY PLAN:

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:

GUARANTEED RATE FIELD - FIRE ALARM REPLACEMENT

333 W 35TH STREET, CHICAGO, ILLINOIS 60616

DRAWING TITLE:

ELECTRICAL FIRE ALARM NEW WORK PLAN - 200 LEVEL - SECTION 4

DESIGNED BY:

MR

CHECKED BY:

BT

PROJECT NO:

22096

SCALE:

1/8" = 1'-0"

SHEET NO.

E1.204

KEYED ELECTRICAL NEW WORK SHEET NOTES


A1. ALTERNATE 1: FURNISH AND INSTALL VISUAL FIRE ALARM DEVICE IN ROOM AS INDICATED. FURNISH AND INSTALL NEW FIRE ALARM CONDUIT AND WIRING AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.

A2. ALTERNATE 2: FURNISH AND INSTALL WEATHER PROOF VISUAL FIRE ALARM DEVICE. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.



KEY PLAN:

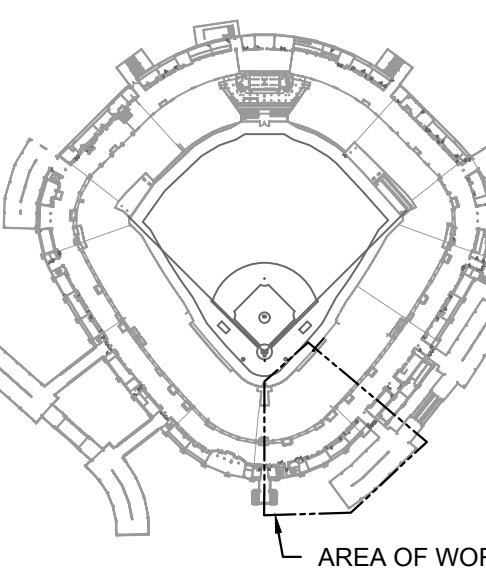

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
	10/03/2023	ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - 200 LEVEL -
SECTION 6

DESIGNED BY:	MR
CHECKED BY:	BT
PROJECT NO:	22096
SCALE:	1/8" = 1'-0"
SHEET NO.	

10/03/2023ISSUED FOR BID

PRELIMINARY - NOT FOR CONSTRUCTION

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 200 LEVEL - SECTION 6 ENLARGED


SCALE: 1/8" = 1'-0"

KEYED ELECTRICAL NEW WORK SHEET NOTES

- A2. ALTERNATE 2: FURNISH AND INSTALL WEATHER PROOF VISUAL FIRE ALARM DEVICE. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.
- A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.



KEY PLAN:

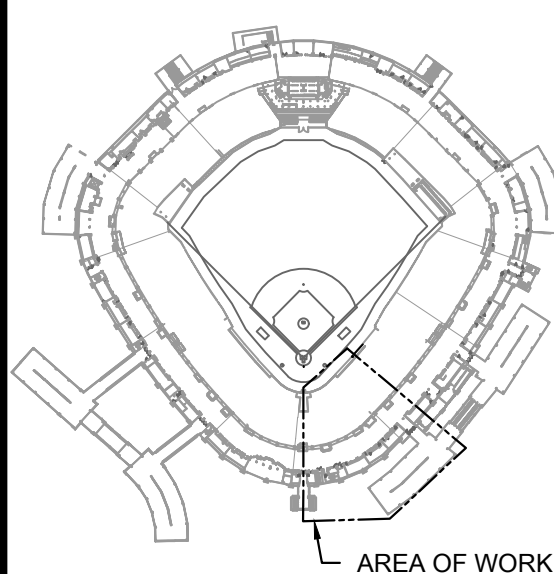

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
10/03/2023		ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:

GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:

ELECTRICAL FIRE ALARM NEW
WORK PLAN - 300 LEVEL -
SECTION 6

DESIGNED BY: MR

CHECKED BY: BT

PROJECT NO: 22096

SCALE: 1/8" = 1'-0"

SHEET NO.

10/03/2023

ISSUED FOR BID

PRELIMINARY - NOT FOR CONSTRUCTION

E1.306

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 300 LEVEL - SECTION 6 ENLARGED

SCALE: 1/8" = 1'-0"



KEYED ELECTRICAL NEW WORK SHEET NOTES


A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 300 LEVEL - SECTION 8 ENLARGED

SCALE: 1/8" = 1'-0"

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

KEY PLAN:

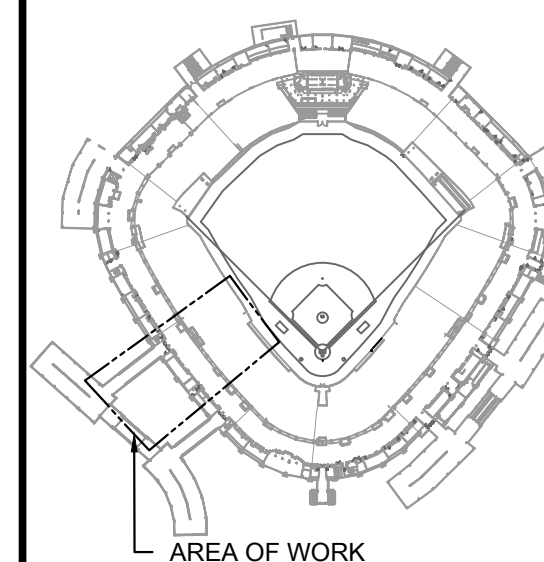

AREA OF WORK

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
	10/03/2023	ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:

GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:

ELECTRICAL FIRE ALARM NEW
WORK PLAN - 300 LEVEL -
SECTION 8


DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"

SHEET NO.

E1.308



E1.309

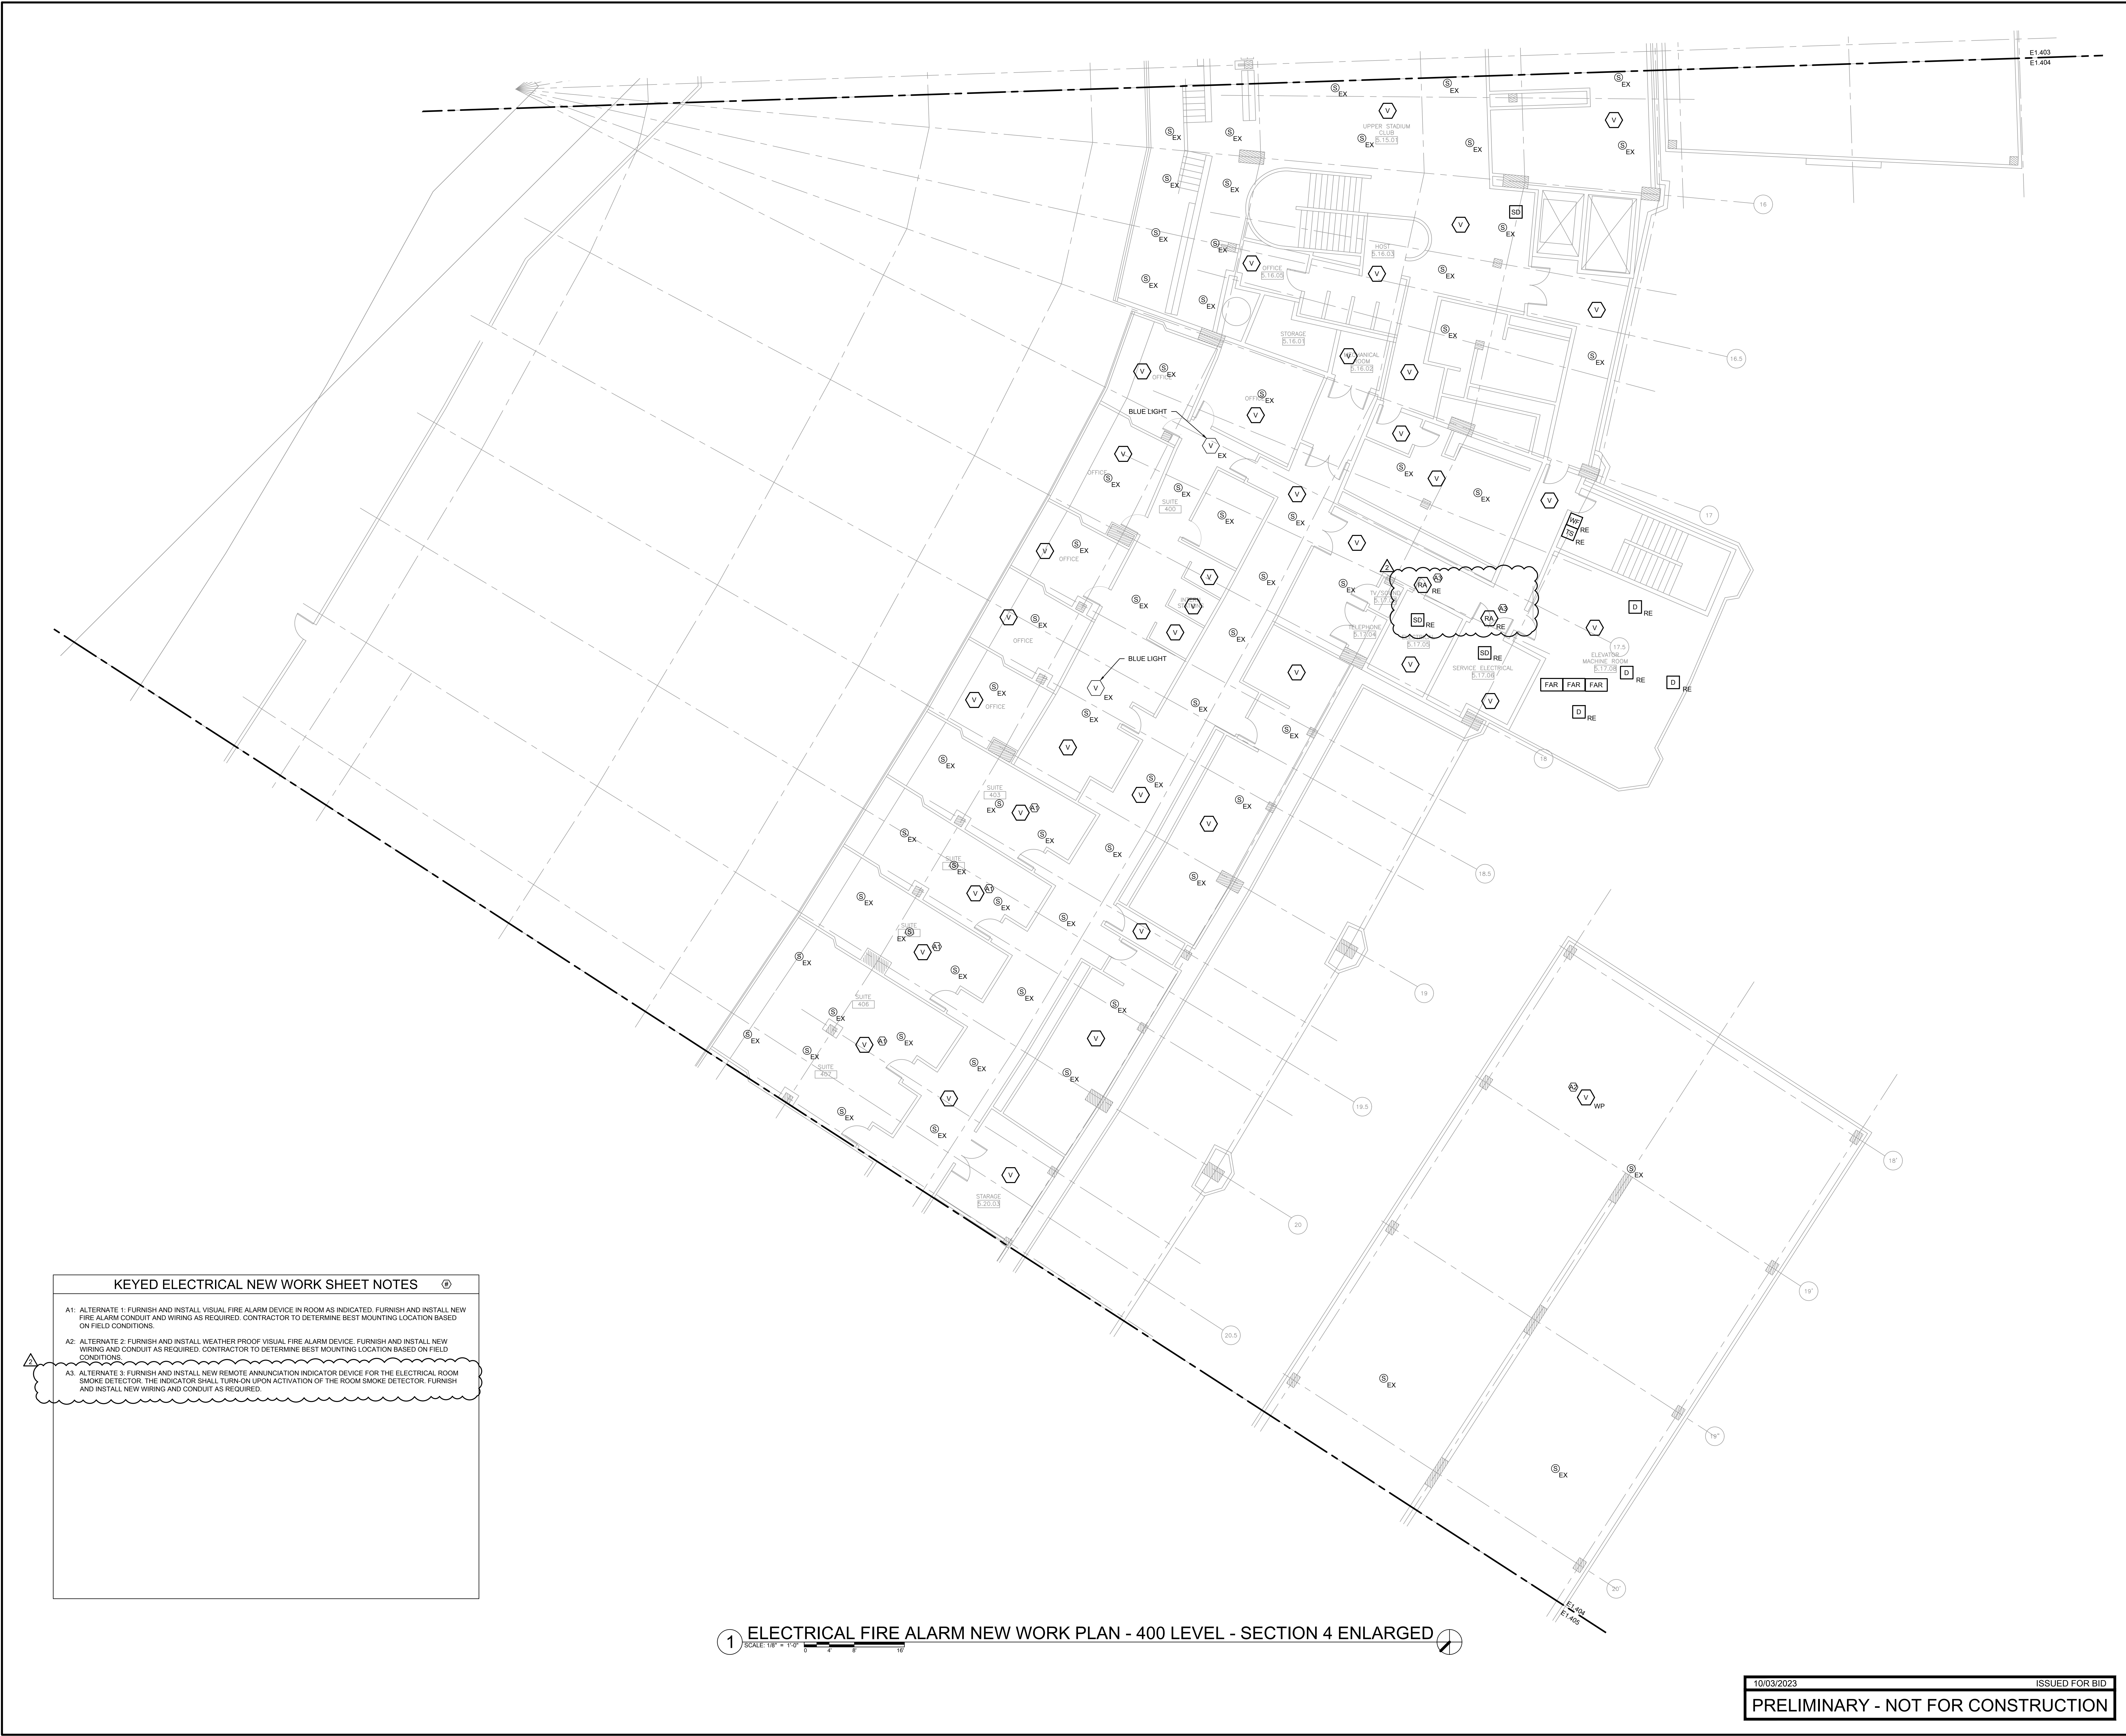

KEYED ELECTRICAL NEW WORK SHEET NOTES

A1: ALTERNATE 1: FURNISH AND INSTALL VISUAL FIRE ALARM DEVICE IN ROOM AS INDICATED. FURNISH AND INSTALL NEW FIRE ALARM CONDUIT AND WIRING AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.

A2: ALTERNATE 2: FURNISH AND INSTALL WEATHER PROOF VISUAL FIRE ALARM DEVICE. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.

A3: ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

1

SCALE: 1/8" = 1'-0"

ELECTRICAL FIRE ALARM NEW WORK PLAN - 400 LEVEL - SECTION 4 ENLARGED

10/03/2023ISSUED FOR BID

PRELIMINARY - NOT FOR CONSTRUCTION

ELARA

elaraeng.com | (708) 236-0300

ISFA

ILLINOIS SPORTS FACILITIES AUTHORITY

SO

ST. LOUIS

KEY PLAN:

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:

GUARANTEED RATE FIELD - FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:

ELECTRICAL FIRE ALARM NEW WORK PLAN - 400 LEVEL - SECTION 4

DESIGNED BY:

MR

CHECKED BY:

BT

PROJECT NO:

22096

SCALE:

1/8" = 1'-0"

SHEET NO.

E1.404

KEYED ELECTRICAL NEW WORK SHEET NOTES


A1: ALTERNATE 1: FURNISH AND INSTALL VISUAL FIRE ALARM DEVICE IN ROOM AS INDICATED. FURNISH AND INSTALL NEW FIRE ALARM CONDUIT AND WIRING AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.

A2: ALTERNATE 2: FURNISH AND INSTALL WEATHER PROOF VISUAL FIRE ALARM DEVICE. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.

A3: ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.



KEY PLAN:

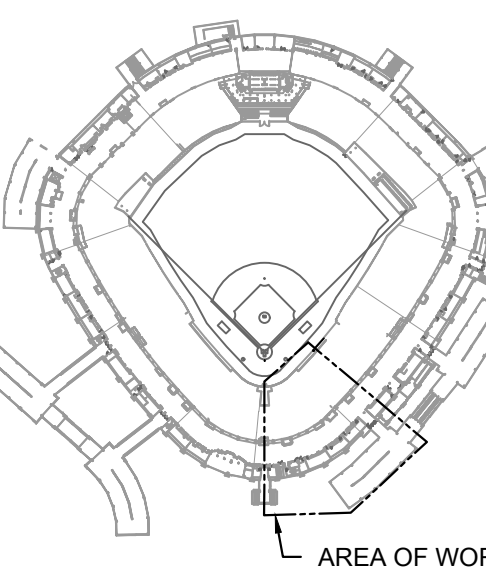

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
2	10/03/2023	ADDENDUM 1
3	10/03/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT
333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - 400 LEVEL -
SECTION 6

DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"
SHEET NO.

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

E1.406






1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 400 LEVEL - SECTION 9 ENLARGED

KEYED ELECTRICAL NEW WORK SHEET NOTES

A1: ALTERNATE 1: FURNISH AND INSTALL VISUAL FIRE ALARM DEVICE IN ROOM AS INDICATED. FURNISH AND INSTALL NEW FIRE ALARM CONDUIT AND WIRING AS REQUIRED. CONTRACTOR TO DETERMINE BEST MOUNTING LOCATION BASED ON FIELD CONDITIONS.

A3: ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

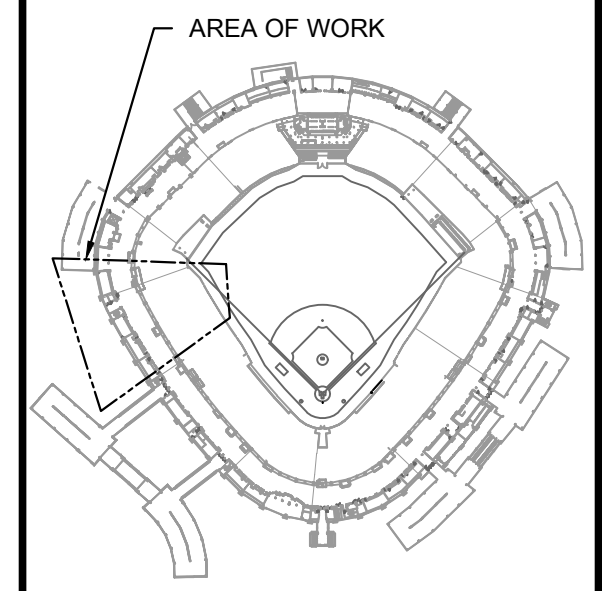

KEY PLAN:


ISSUE/REVISION:		
REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
2	10/03/2023	ADDENDUM 1
3	10/03/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - 400 LEVEL -
SECTION 9

DESIGNED BY:	MR
CHECKED BY:	BT
PROJECT NO:	22096
SCALE:	1/8" = 1'-0"
SHEET NO.	

10/03/2023ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

E1.409






elaraeng.com | (708) 236-0300



INLAND SPOKES
FACTORIES AUTHORITY



KEY PLAN:

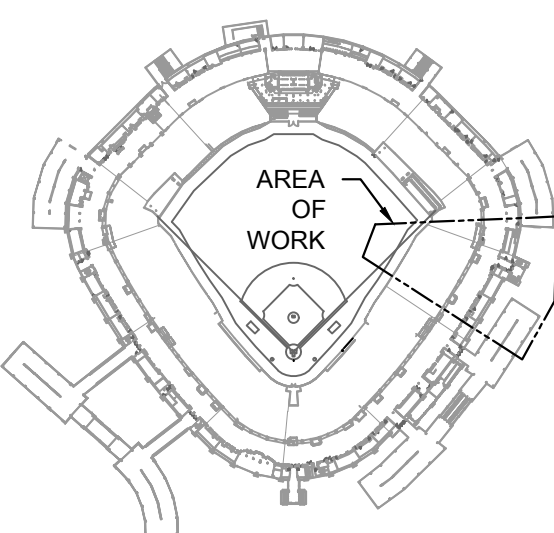

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
2	10/03/2023	ADDENDUM 1
3	10/03/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616


DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - 500 LEVEL -
SECTION 4

DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"

SHEET NO.

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

E1.504

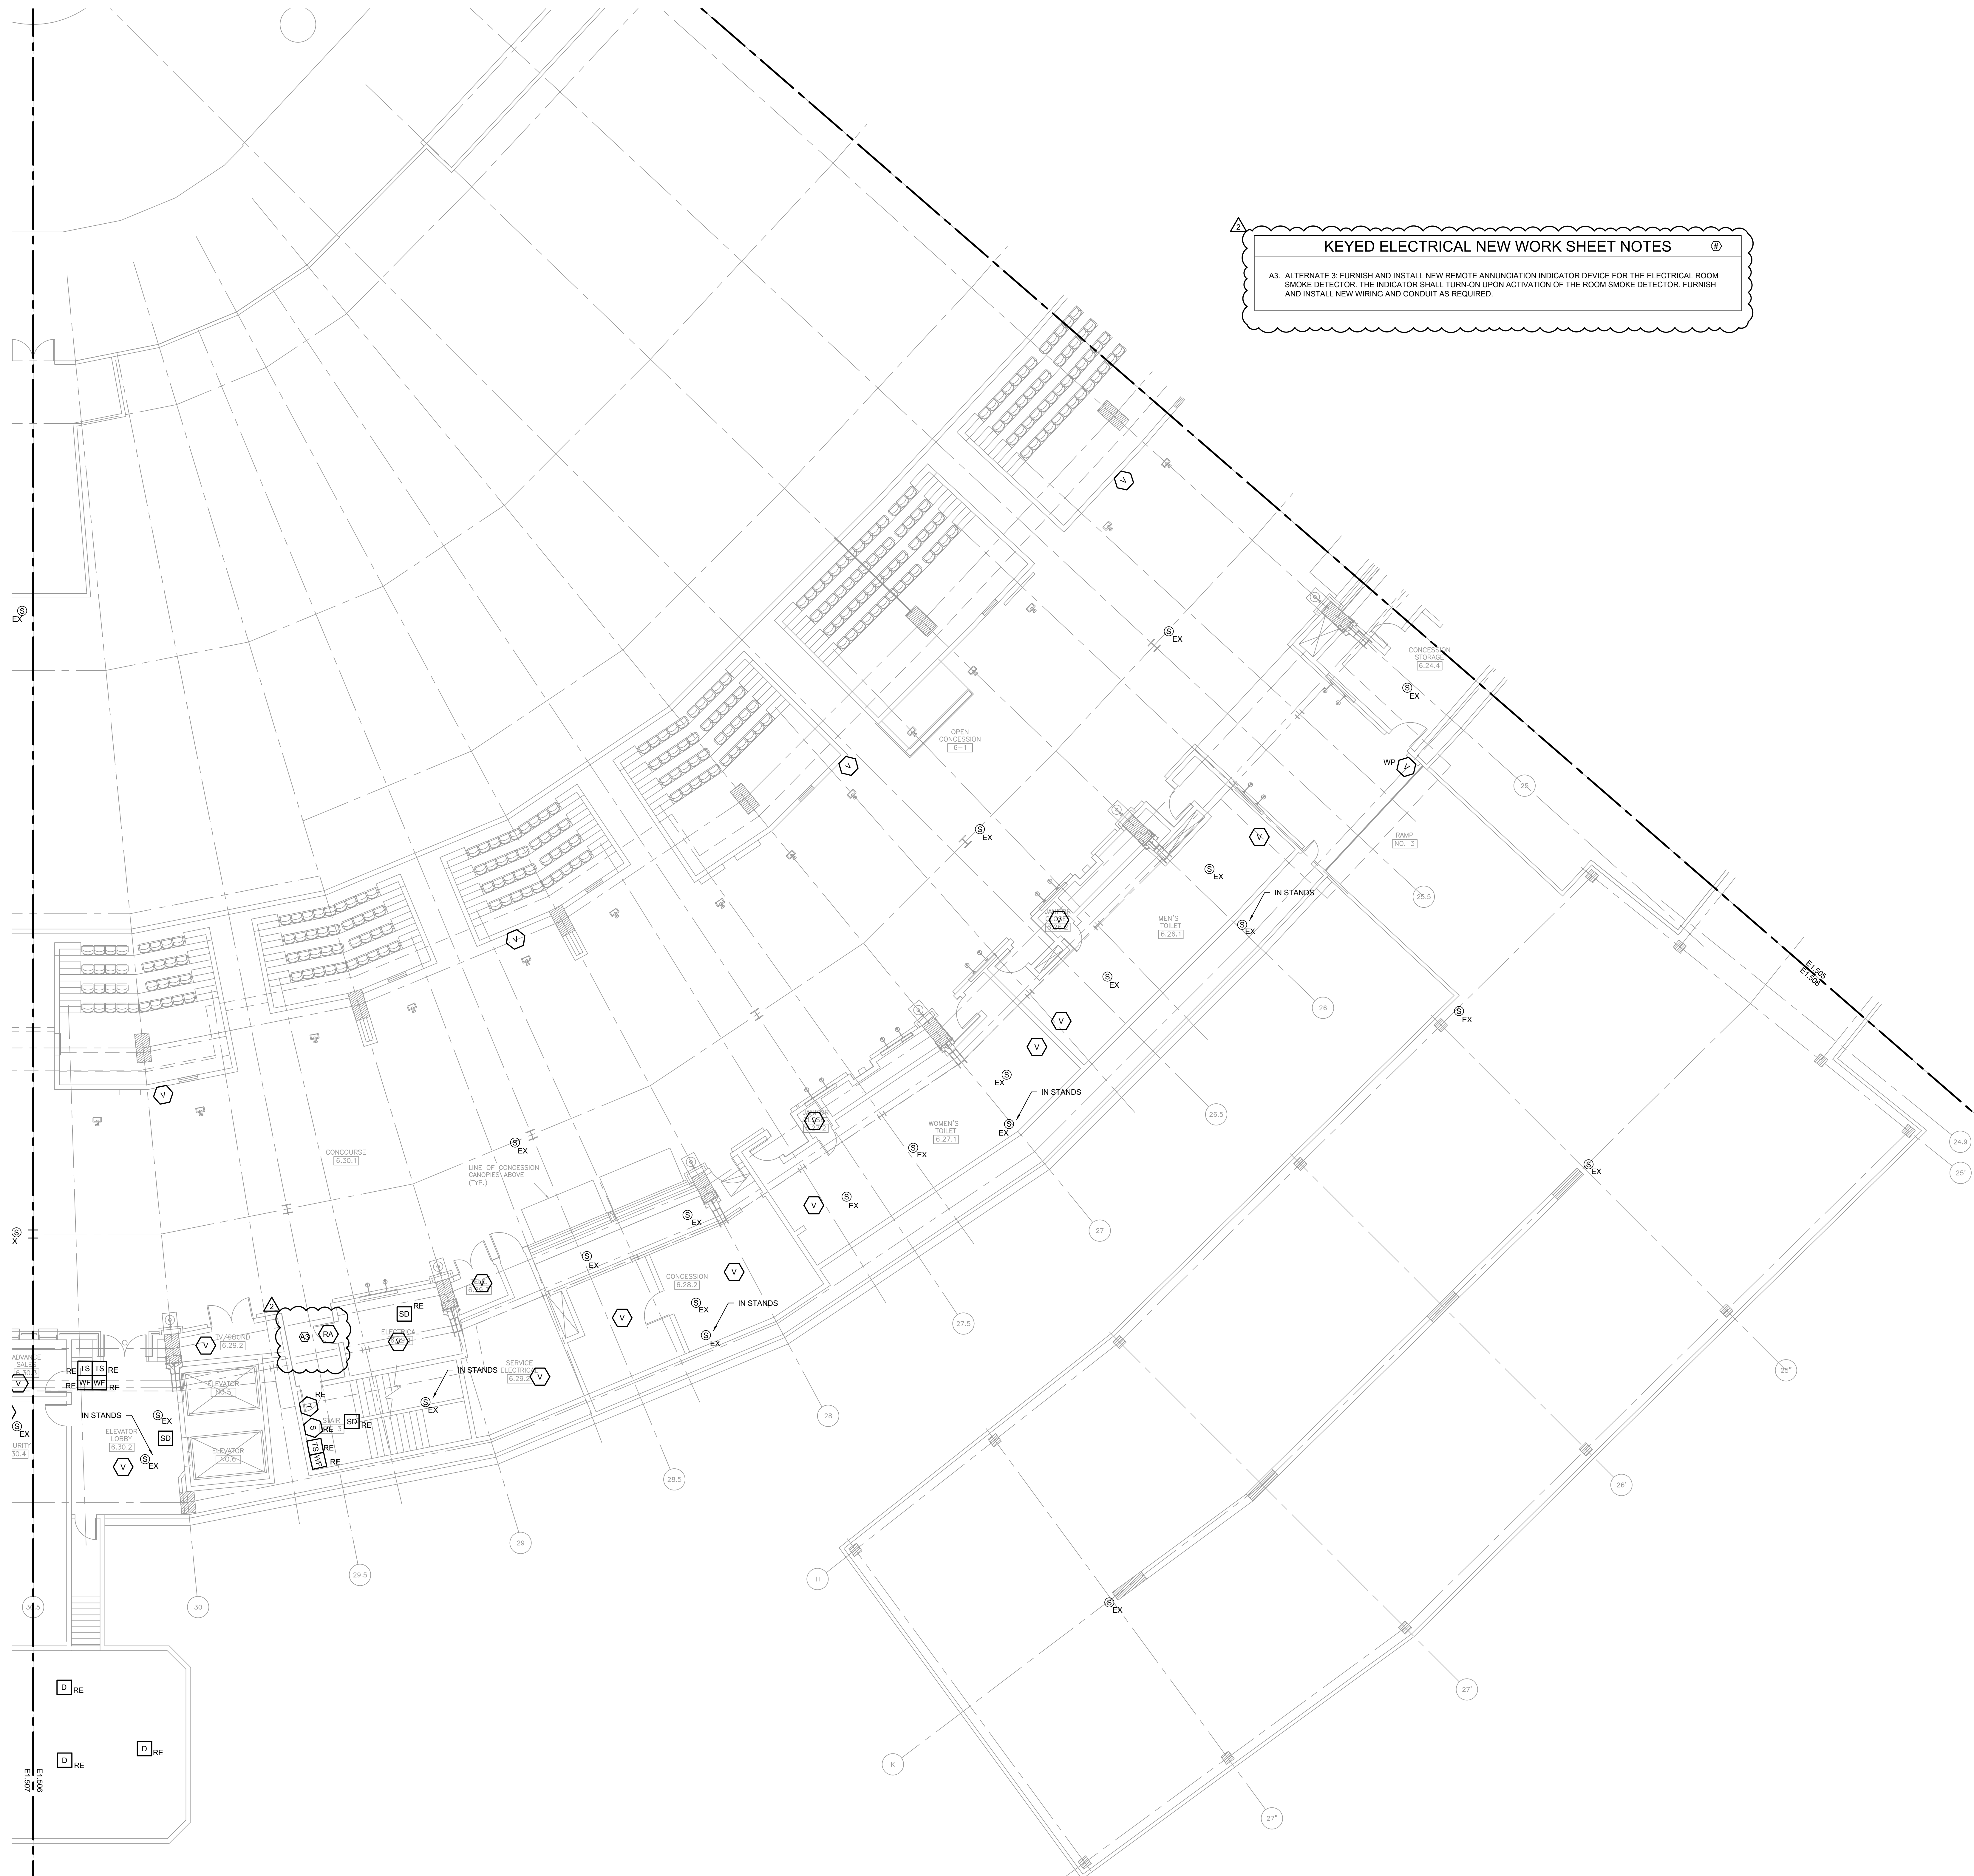


KEYED ELECTRICAL NEW WORK SHEET NOTES

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 500 LEVEL - SECTION 6 ENLARGED

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

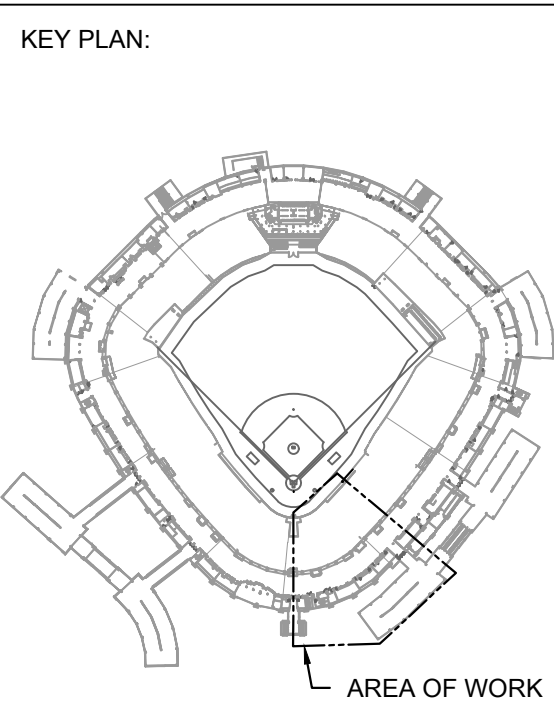

ISSUE/REVISION:		
REV.	DATE	DESCRIPTION
1	10/03/2023	ISSUED FOR BID
2	10/03/2023	ADDENDUM 1
3	10/03/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT
333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - 500 LEVEL -
SECTION 6

DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"
SHEET NO:

E1.506




KEYED ELECTRICAL NEW WORK SHEET NOTES

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

1 ELECTRICAL FIRE ALARM NEW WORK PLAN - 500 LEVEL - SECTION 9 ENLARGED

SCALE: 1/8" = 1'-0"

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

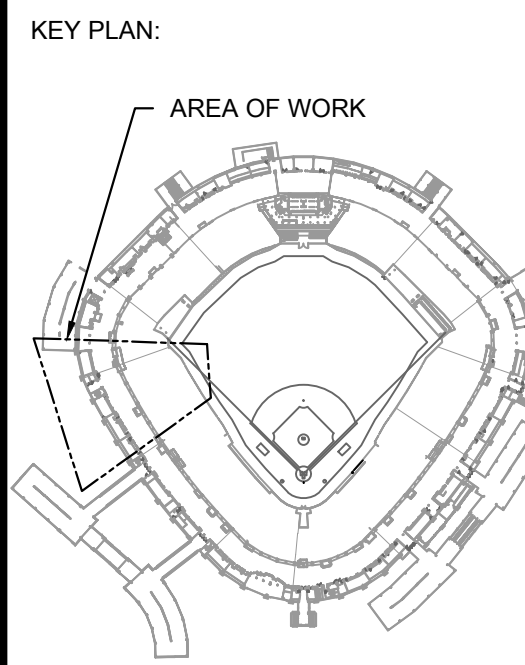


ISSUE/REVISION:		
REV.	DATE	DESCRIPTION
	10/03/2023	ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT

333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - 500 LEVEL -
SECTION 9

DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"
SHEET NO:

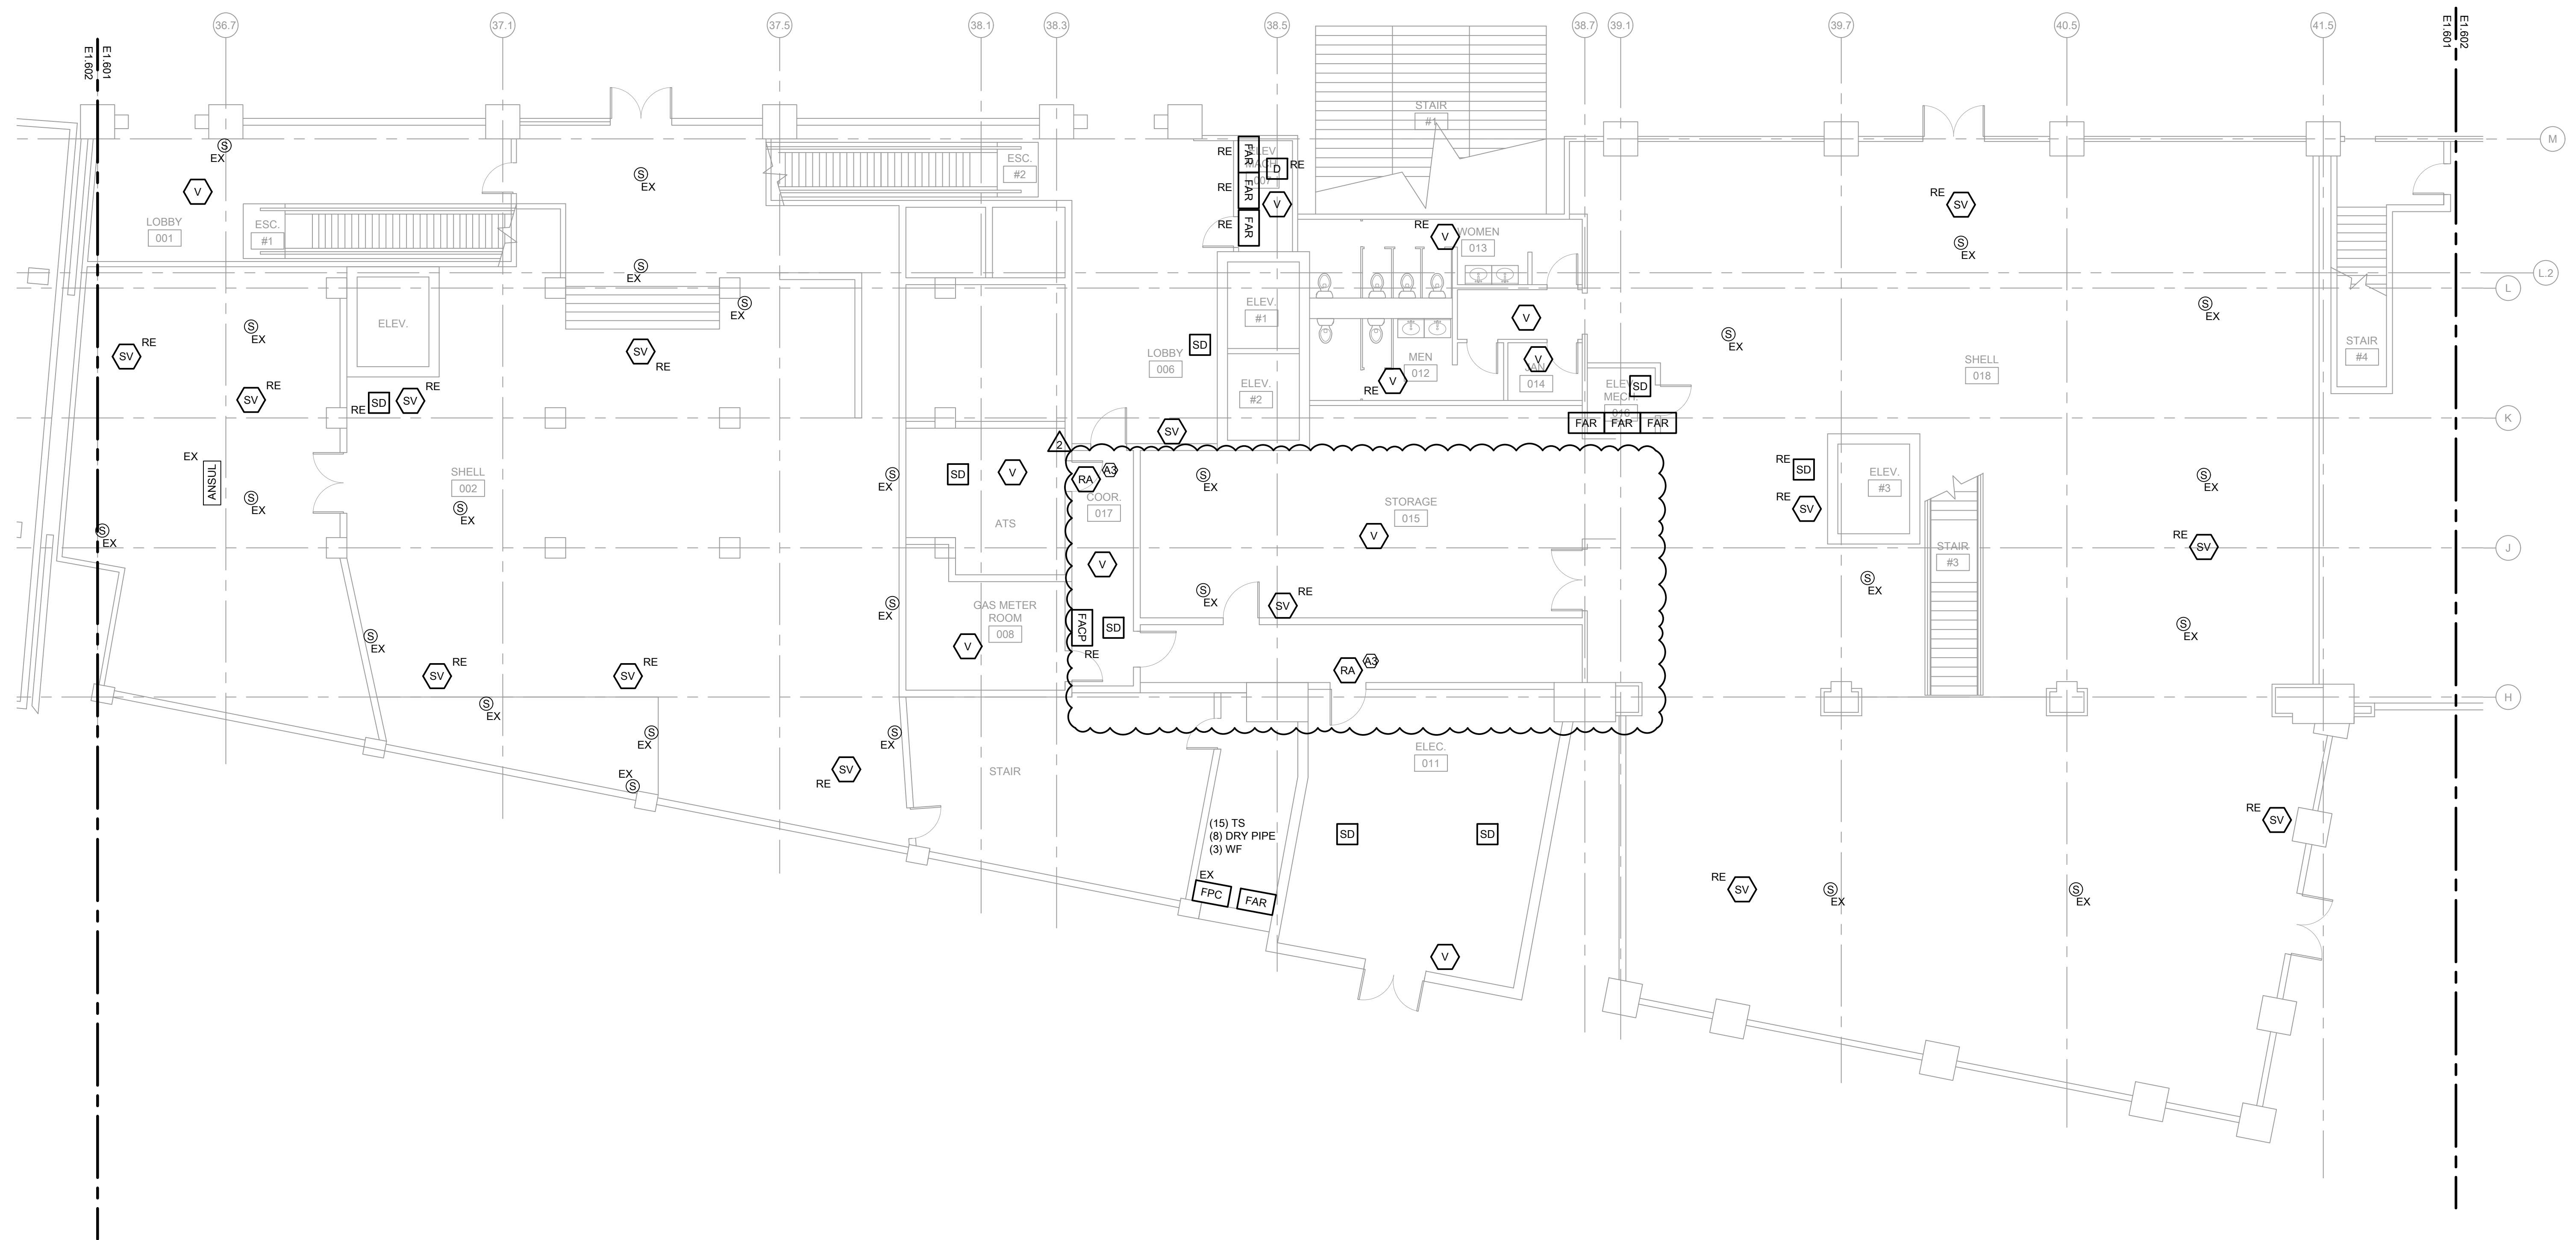


1 ELECTRICAL FIRE ALARM NEW WORK PLAN - PLAZA LEVEL - 320 W 35TH - SECTION 2

SCALE 1/8" = 1'-0"

KEYED ELECTRICAL NEW WORK SHEET NOTES

A3. ALTERNATE 3: FURNISH AND INSTALL NEW REMOTE ANNUNCIATION INDICATOR DEVICE FOR THE ELECTRICAL ROOM SMOKE DETECTOR. THE INDICATOR SHALL TURN-ON UPON ACTIVATION OF THE ROOM SMOKE DETECTOR. FURNISH AND INSTALL NEW WIRING AND CONDUIT AS REQUIRED.

KEY PLAN:

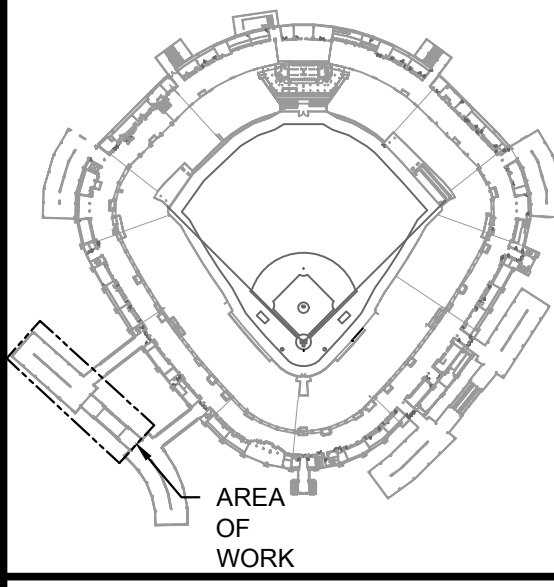

ISSUE/REVISION:

REV.	DATE	DESCRIPTION
	10/03/2023	ISSUED FOR BID
1	10/18/2023	ADDENDUM 1
2	10/23/2023	ADDENDUM 2

PROJECT:
GUARANTEED RATE FIELD -
FIRE ALARM REPLACEMENT
333 W 35TH STREET,
CHICAGO, ILLINOIS 60616

DRAWING TITLE:
ELECTRICAL FIRE ALARM NEW
WORK PLAN - PLAZA LEVEL

DESIGNED BY: MR
CHECKED BY: BT
PROJECT NO: 22096
SCALE: 1/8" = 1'-0"
SHEET NO:

10/03/2023 ISSUED FOR BID
PRELIMINARY - NOT FOR CONSTRUCTION

E1.601